


GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT			SERVICE		GPM CAPACITY	FT. TDH
					% EFFICIENCY	RPM

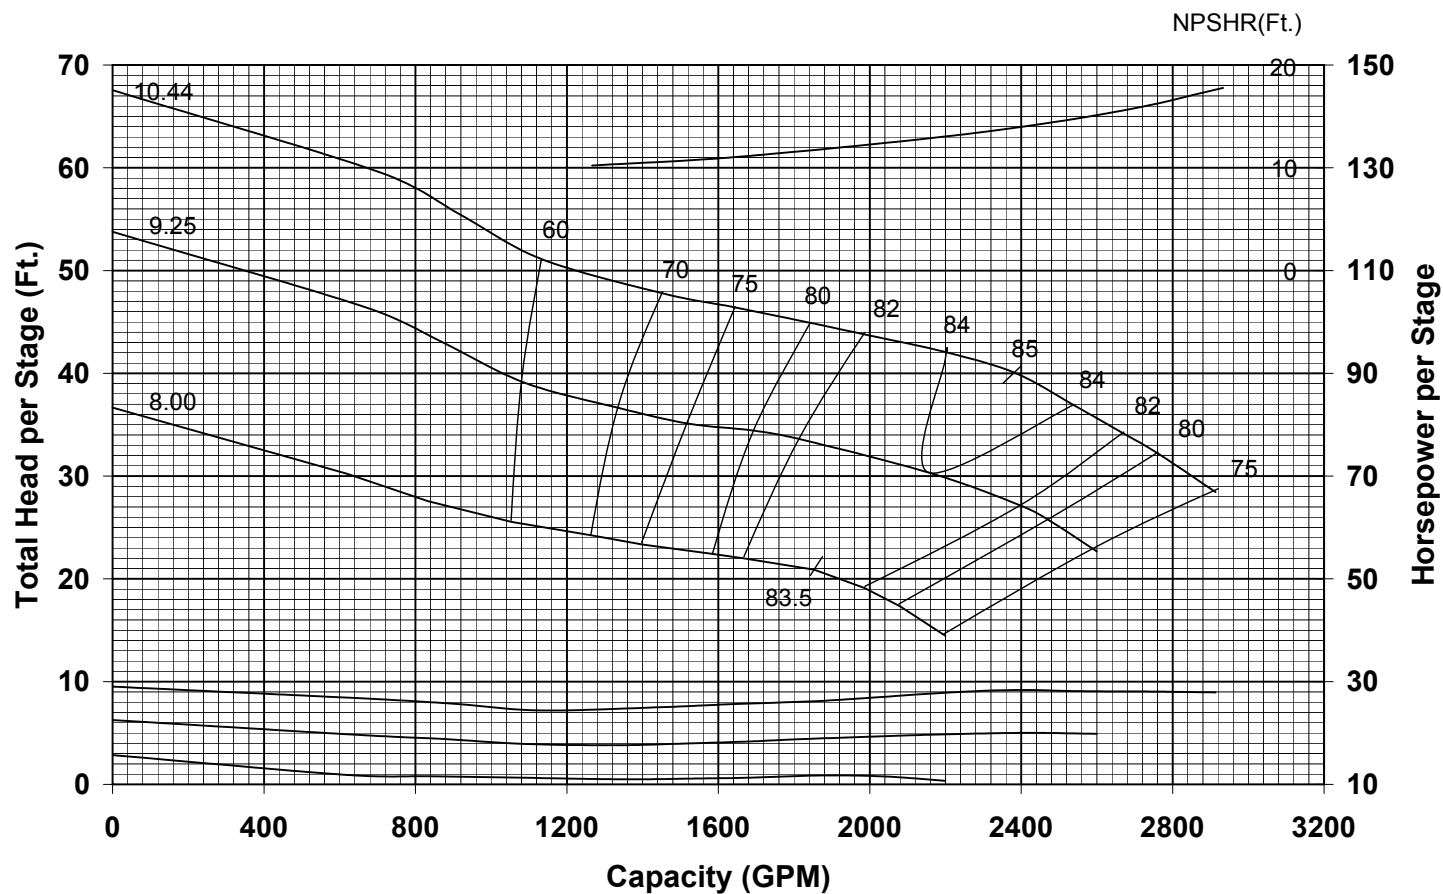

Curve No. E6616DFPC0	
Model 16DHLO	
RPM 1180	
EFFICIENCY CORRECTION	
1-STAGE	-1.0
2-STAGE	
3-STAGE	
4-STAGE	
Impeller OPEN	
Ns = 3615	
K = 42.0 LBS/FT	
K(Bal.)= N/A	
Bowl O.D.	15.25"
Bowl Lateral	0.88"
Max. PSI	240
Min. Subm	28"
GOULDS PUMPS	
TURBINE OPERATIONS	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	