


GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT		SERVICE		GPM CAPACITY		FT. TDH
						% EFFICIENCY
						RPM

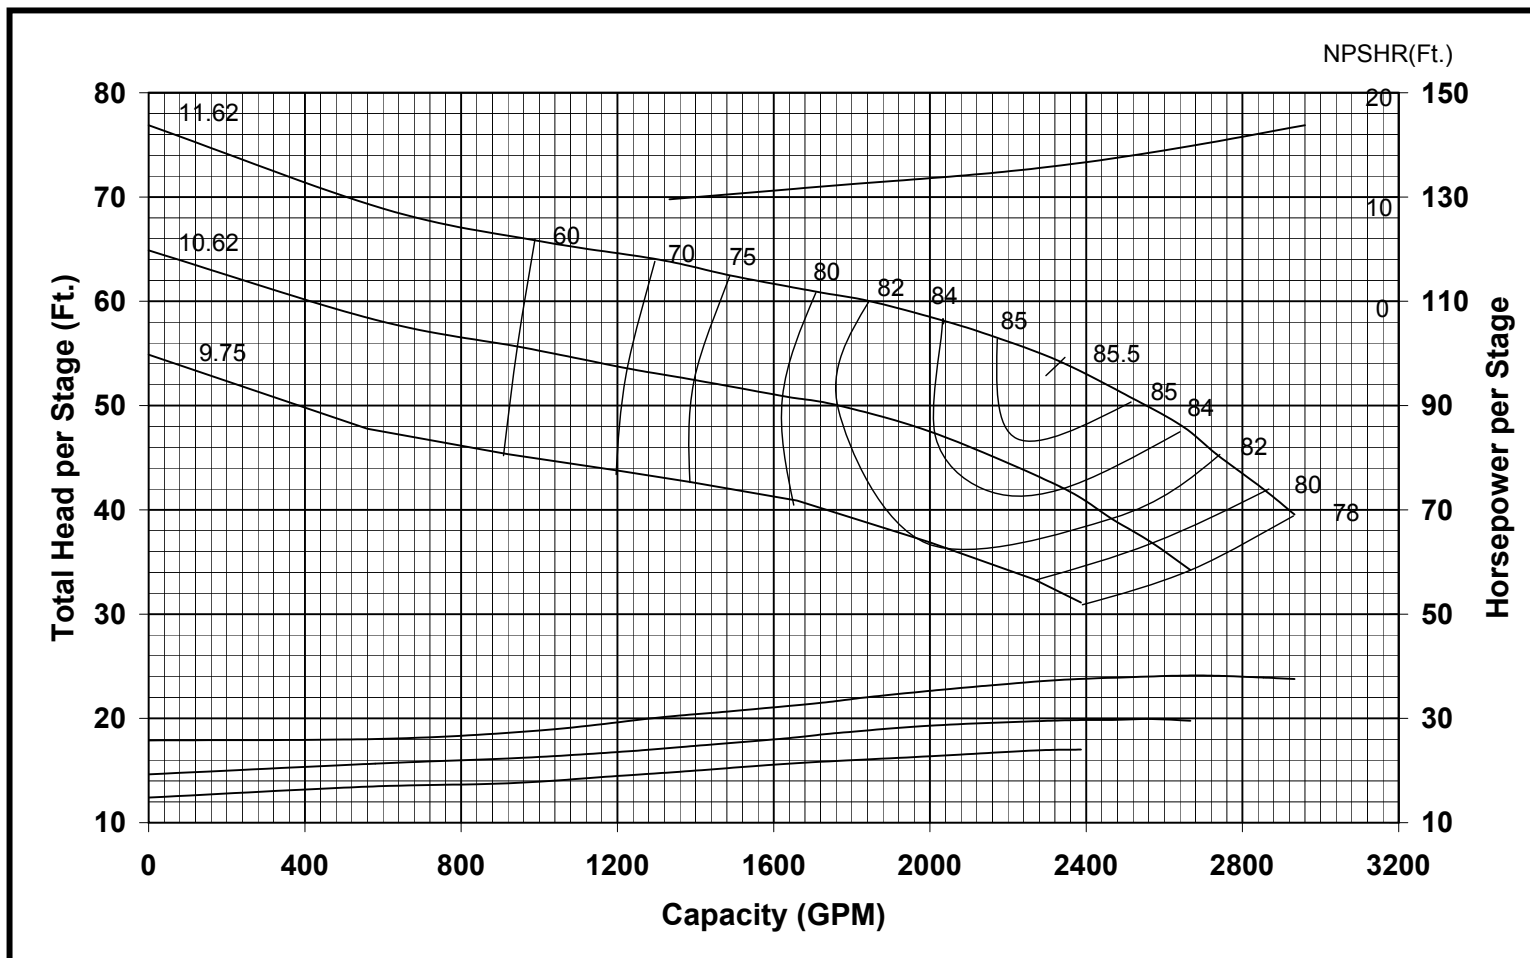

Curve No. E6616DHPC0	
Model 16DMC	
RPM 1180	
EFFICIENCY CORRECTION	
1-STAGE	-1.0
2-STAGE	
3-STAGE	
4-STAGE	
Impeller ENCLOSED	
Ns = 2859	
K = 18.0 LBS/FT	
K(Bal.)= N/A	
Bowl O.D.	16.0"
Bowl Lateral	0.75"
Max. PSI	335
Min. Subm	28"
GOULDS PUMPS	
TURBINE OPERATIONS	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	