



GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT		SERVICE		GPM CAPACITY		FT. TDH
						% EFFICIENCY
						RPM

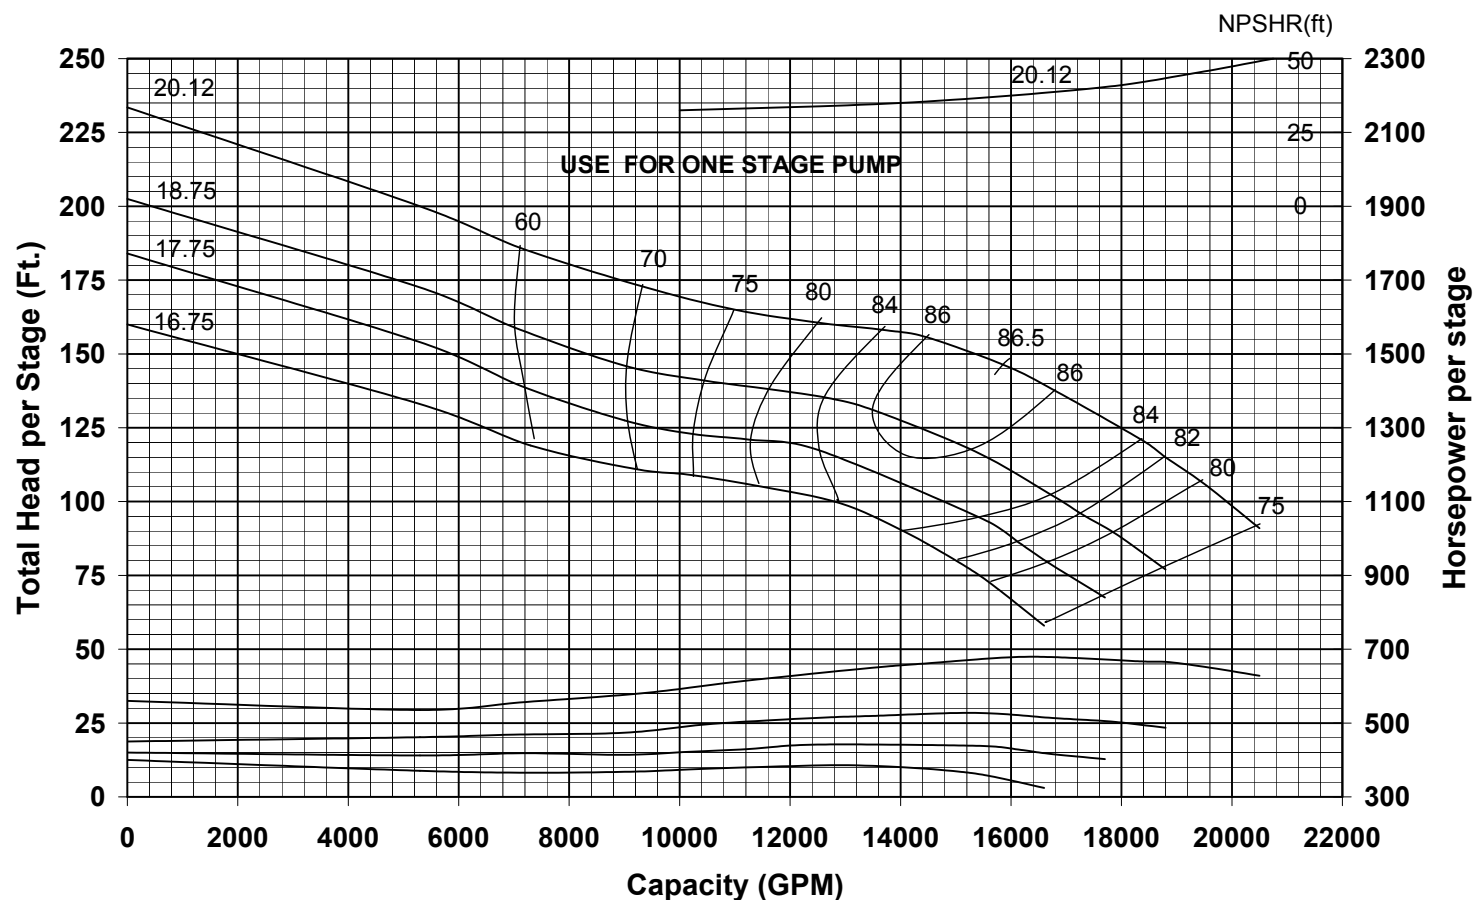

Curve No. E6630BDPC2	
Model	30BHC
RPM	1180
EFFICIENCY CORRECTION	
1-STAGE	
2-STAGE	
3-STAGE	
Bal. Imp.	-2.0
Impeller ENCLOSED	
Ns =	3527
K =	92.0 LBS/FT
K (Bal.)=	23.0 LBS/FT
Bowl O.D.	29.50"
Bowl Lateral	0.87"
Max. PSI	216
Min. Subm	68"
GOULDS PUMPS	
TURBINE OPERATIONS	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	

GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT		SERVICE		GPM CAPACITY	FT. TDH	% EFFICIENCY
						RPM

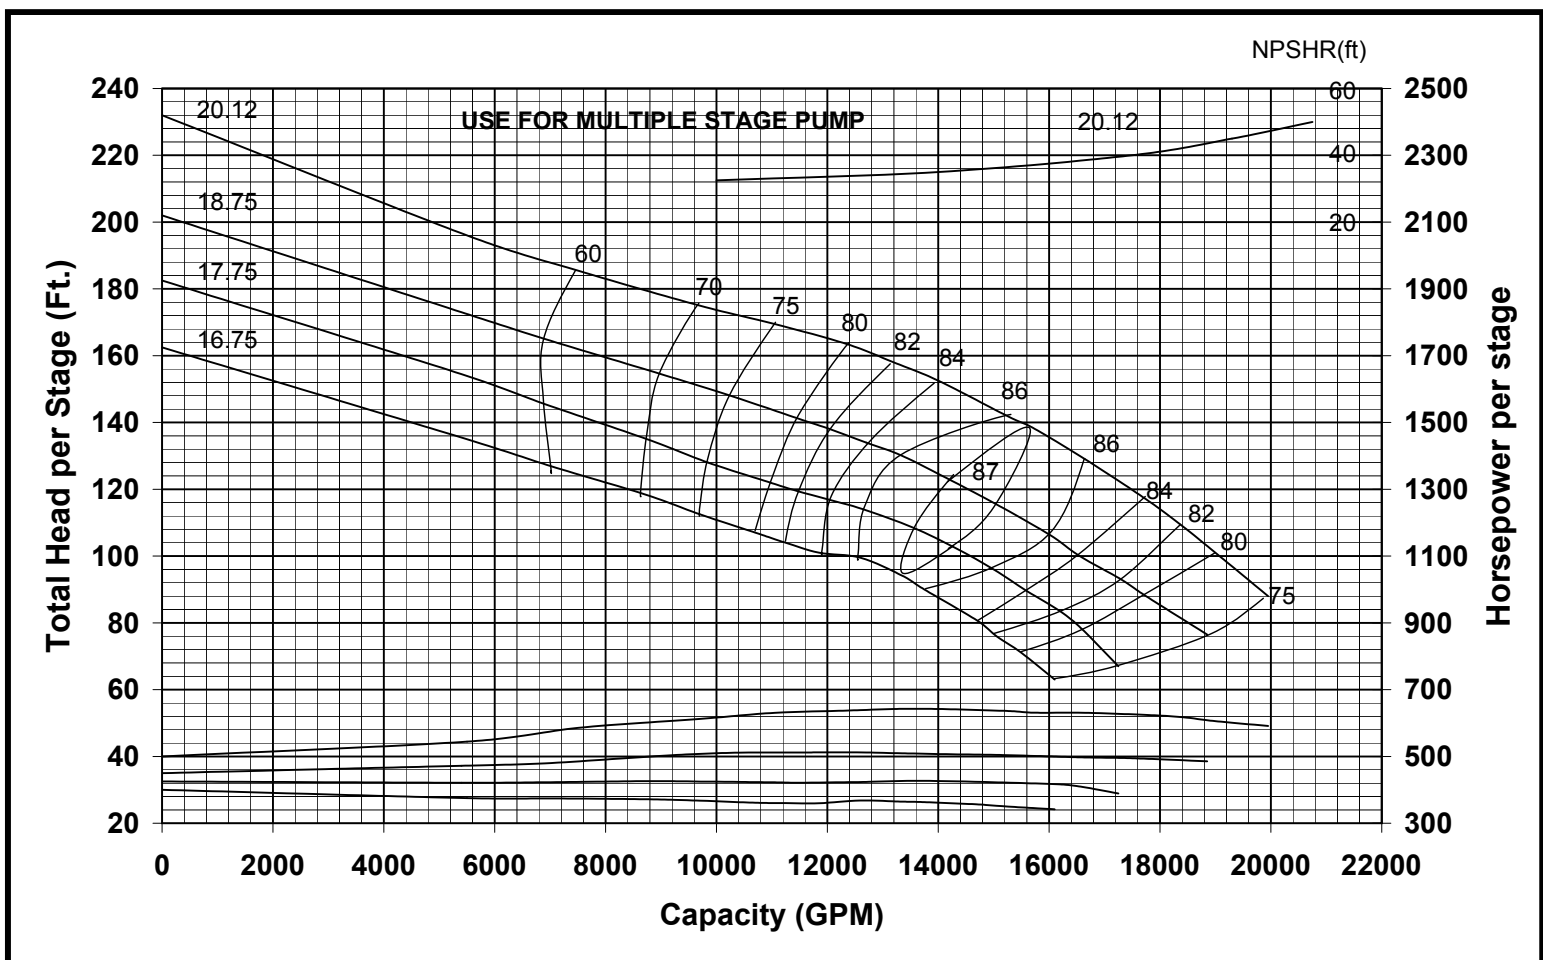

Curve No. E6630BCPC1	
Model 30BHC	
RPM 1180	
EFFICIENCY CORRECTION	
1-STAGE	
2-STAGE	
3-STAGE	
Bal. Imp.	-2.0
Impeller ENCLOSED	
Ns = 3687	
K = 92.0 LBS/FT	
K (Bal.)= 23.0 LBS/FT	
Bowl O.D.	29.50"
Bowl Lateral	0.87"
Max. PSI	216
Min. Subm	68"
GOULDS PUMPS	
TURBINE OPERATIONS	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	