


GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT		SERVICE		GPM CAPACITY		FT. TDH
						% EFFICIENCY
						RPM

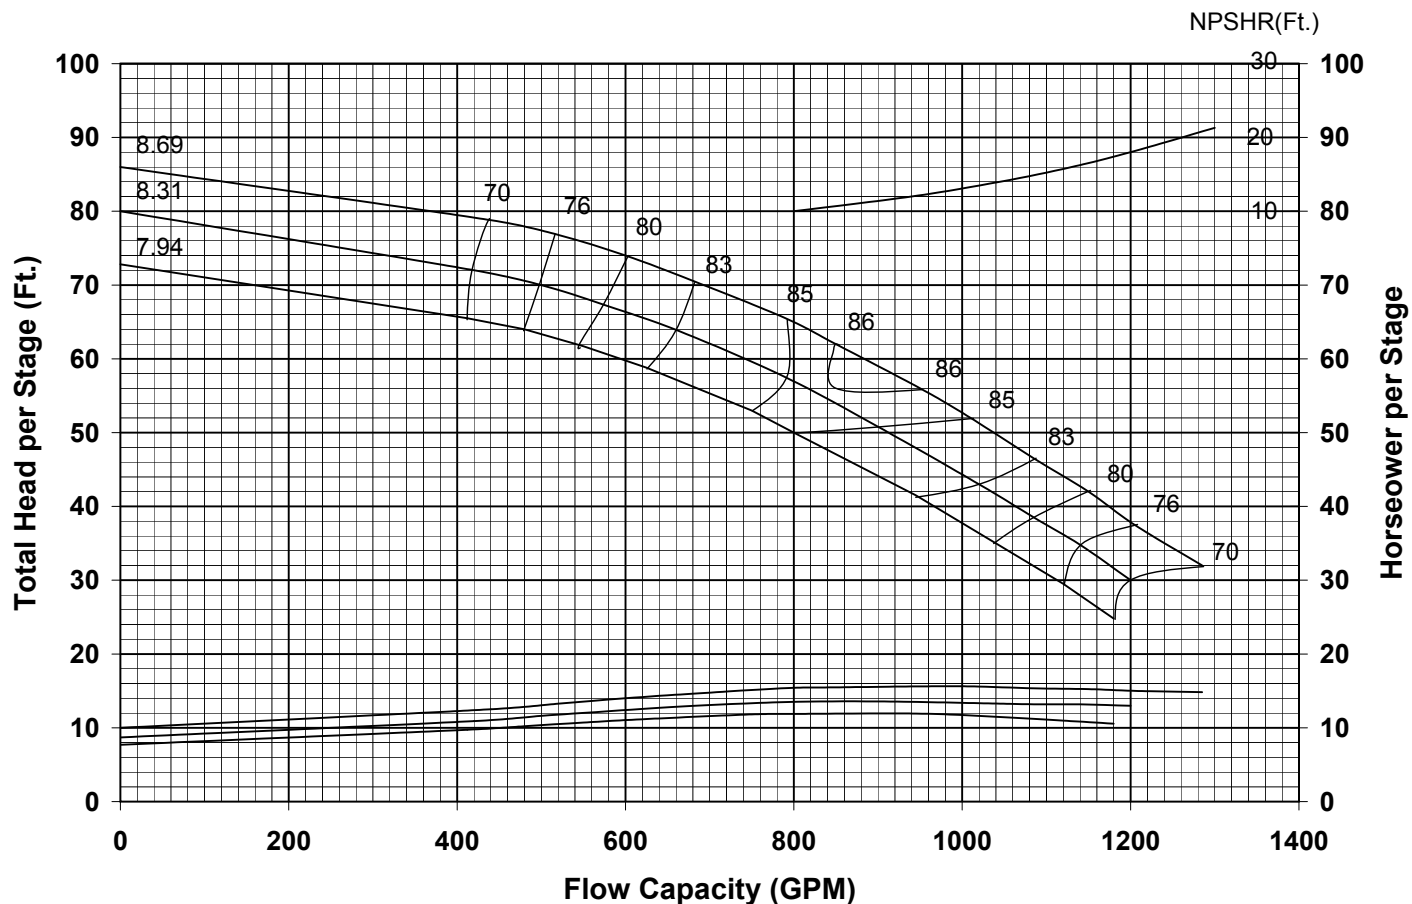

Curve No. E6412CJPC0	
Model 12CLO	
RPM 1770	
EFFICIENCY CORRECTION	
1-STAGE	-3.0
2-STAGE	-2.0
3-STAGE	-0.5
4-STAGE	0.0
Impeller OPEN	
Ns = 2260	
K = 10.0 LBS/FT	
K(Bal.)= N/A	
Bowl O.D.	11.75"
Bowl Lateral	1.00"
Max. PSI	340
Disch size	6",8",10"
GOULDS PUMPS	
TURBINE OPERATIONS	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	