


GOULDS PROPOSAL NO.	GOULDS S.O. NO.	INQUIRY NO.	CUSTOMER P.O. NO.	P.O. DATE	ITEM NO.	CUSTOMER
PROJECT		SERVICE		GPM CAPACITY		FT. TDH
						% EFFICIENCY
						RPM

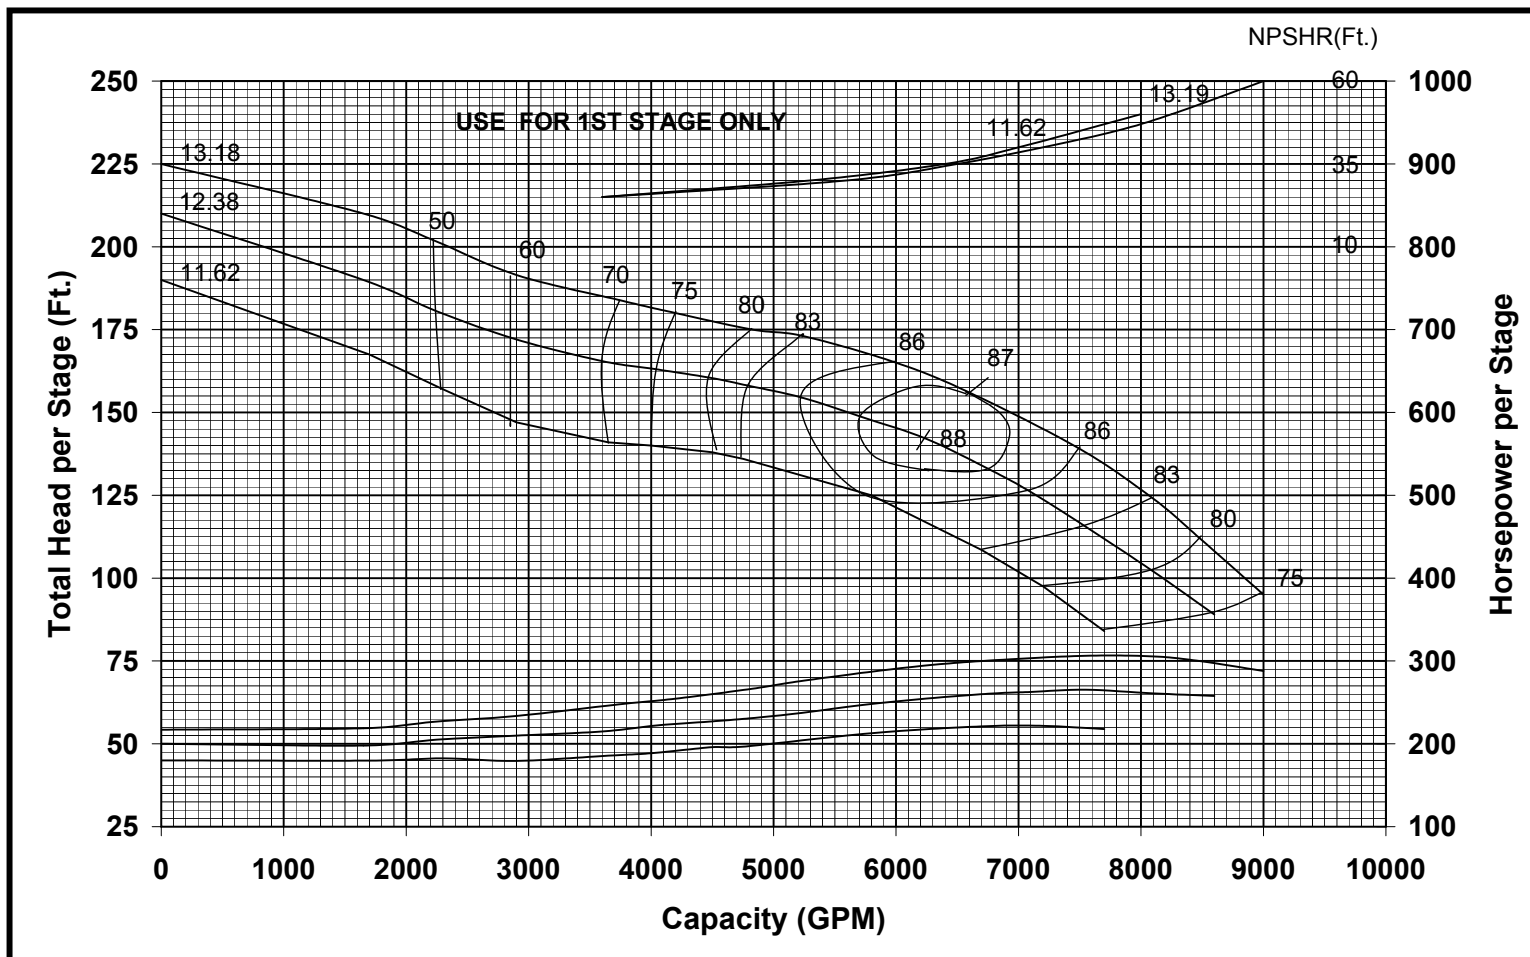

Curve No.	
E6420EBPC2	
Model	20EHC
RPM	1770
EFFICIENCY CORRECTION	
1-STAGE	
2-STAGE	
3-STAGE	
4-STAGE	
Impeller	ENCLOSED
Ns =	3325
K =	36.0 LBS/FT
K(Bal.)=	N/A
Bowl O.D.	18.94"
Bowl Lateral	0.88"
Max. PSI	380
Min. Subm	46"
GOULDS PUMPS	
TURBINE OPERATIONS	
Lubbock, Texas	
BOWL PERFORMANCE CURVE BASED ON PUMPING CLEAR, NON-AERATED WATER. RATED POINT ONLY IS GUARANTEED. CURVES REPRESENT SINGLE STAGE PERFORMANCE BASED ON TEST OF MULTI-STAGE BOWL ASSEMBLY. EFFICIENCY CORRECTION IS REQUIRED FOR LESSER STAGES.	