


VTP VERTICAL PUMPS

Sheet 320.05
December 1, 1993
New Sheet

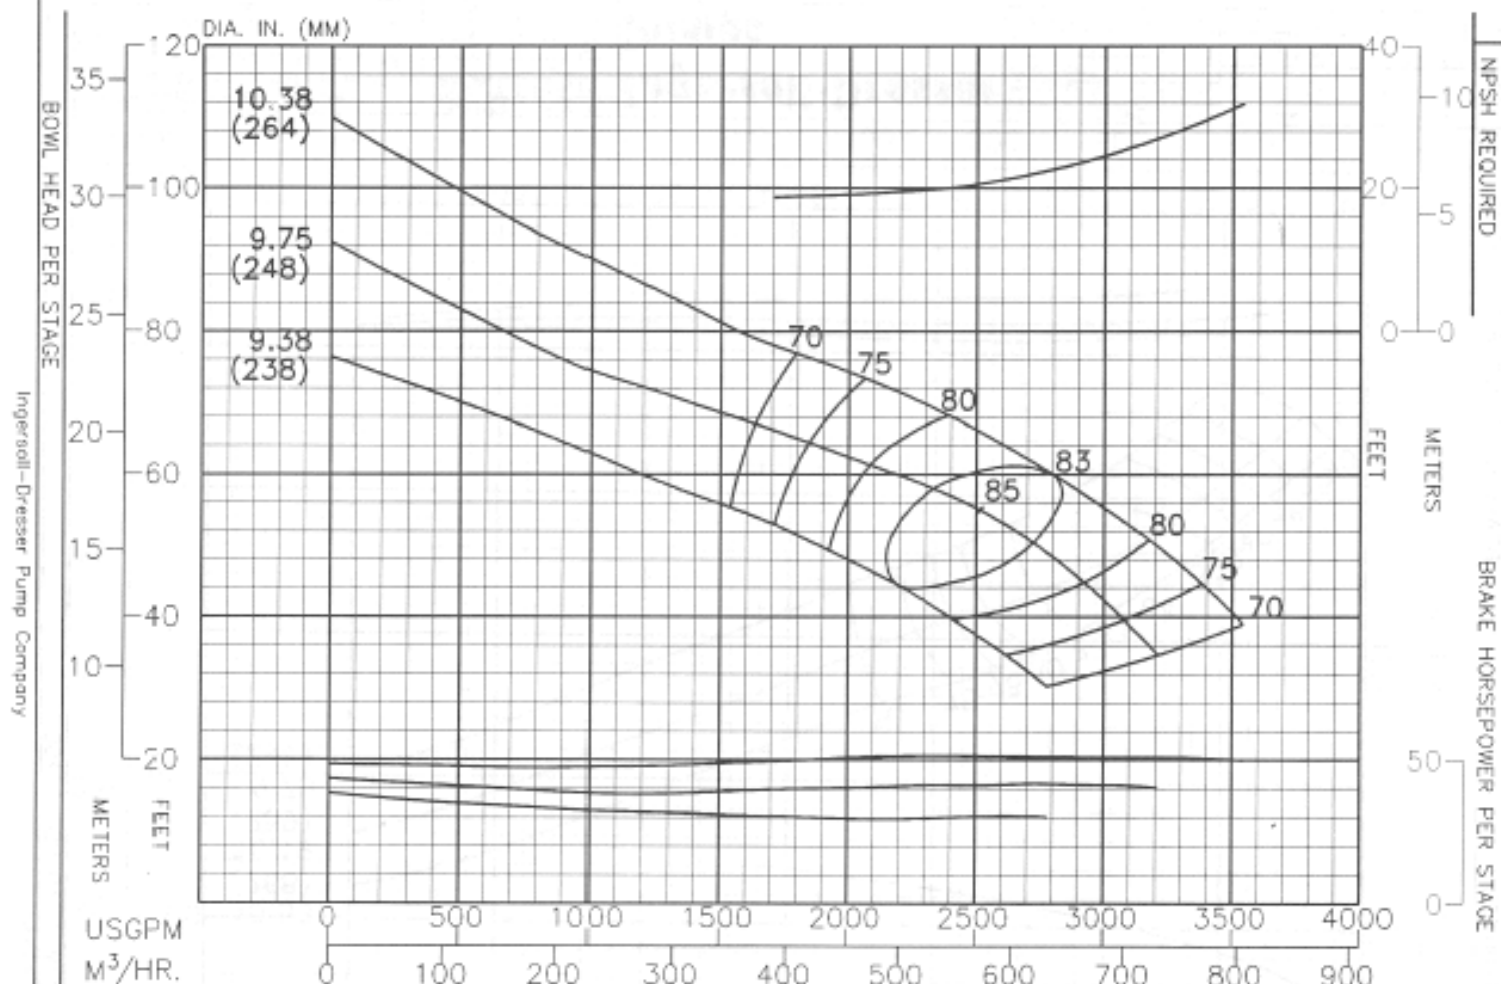

PERFORMANCE BASED ON PUMPING
CLEAR WATER BELOW 85°F. WITH LISTED
MATLS. COLUMN LOSSES NOT INCLUDED.

BOWL - CAST IRON - LINED
IMPELLER - BRONZE

CHANGE	IN EFF.
STAGES	POINTS
1	-1
2	-1
3	-1

Ingersoll-Dresser
Pumps

THRUST FACTORS AT BEP	
IMPELLER LBS/FT	KG/M
STANDARD 15.3	22.8
BALANCED ---	---
Eye Area- 44.2 SQ. IN.	

RPM
1775

ENCLOSED
IMPELLER
N_s = 4370

PUMP
14HH276

CURVE NO.
EC-2426