APW - VERTICAL PUMPS

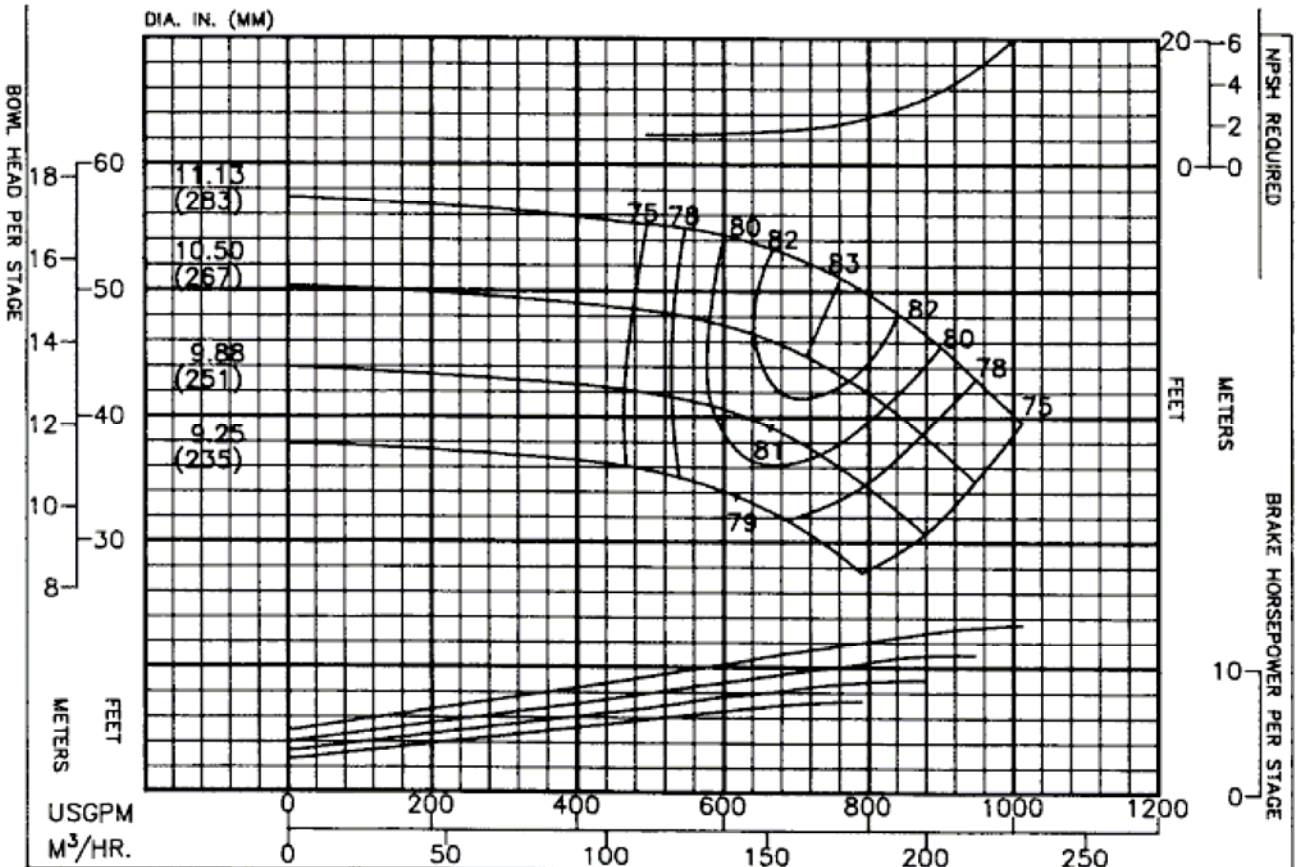

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE IN EFF. STAGES / POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP: IMPELLER LBS/FT KG/M; STANDARD 5.4 8.0; BALANCED 2.6 3.9; EYE AREA-18.6 SQ. IN.	RPM 1175	PUMP 14JKH
BOWL – CAST IRON – LINED	1 / 1½			ENCLOSED IMPELLER	CURVE NO.
IMPELLER – BRONZE	2 / 1			N_s = 1700	EC–1453
	3 / ½				
	4 / 0				