APW - VERTICAL PUMPS

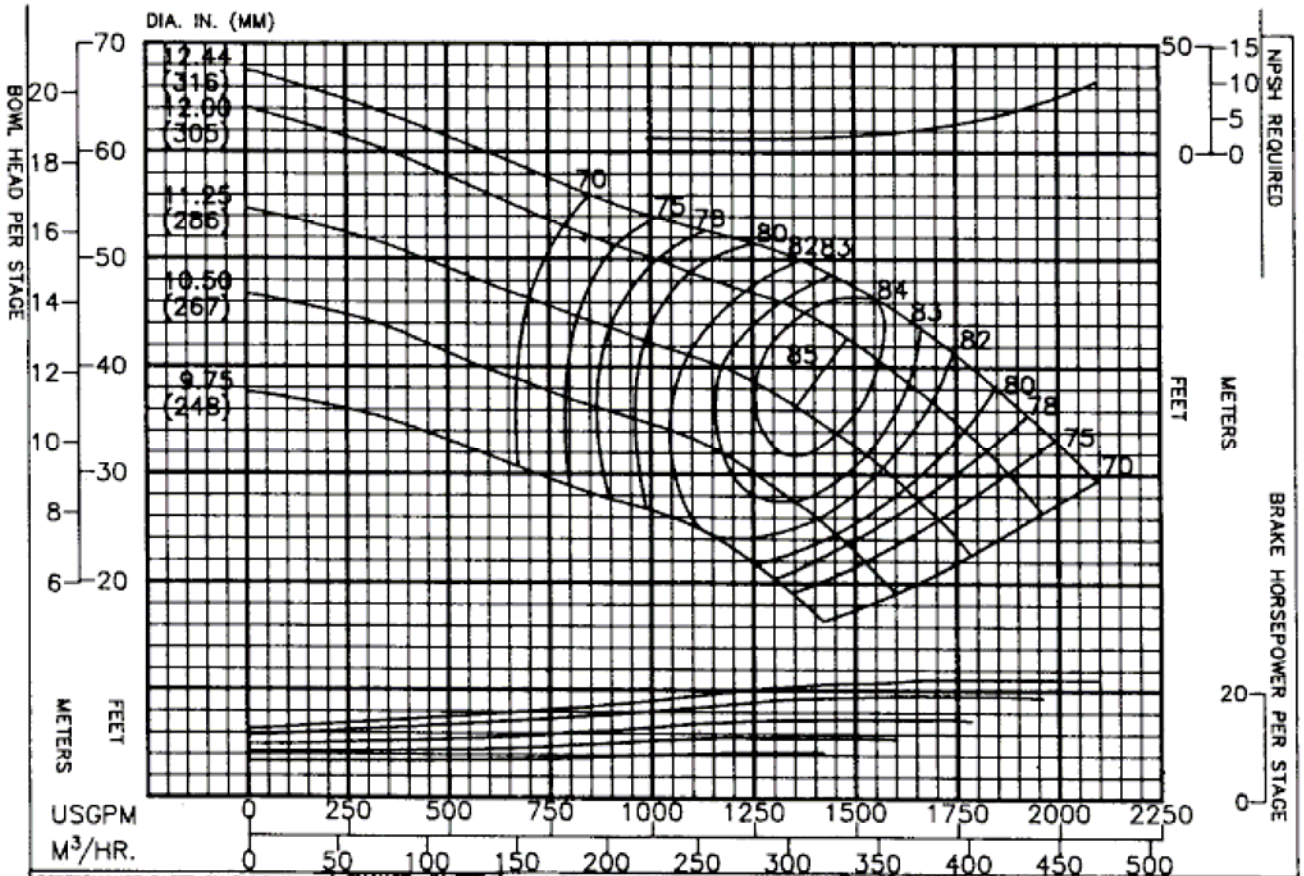

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP: IMPELLER LBS/FT KG/M; STANDARD 11.4 17.0; BALANCED 4.5 6.7; EYE AREA-31.3 SQ. IN.	RPM 1175	PUMP 16KKH
BOWL - CAST IRON - LINED	1	-1			ENCLOSED IMPELLER	CURVE NO.
IMPELLER - BRONZE	2	0			N_s = 2610	EC-1400