APW - VERTICAL PUMPS

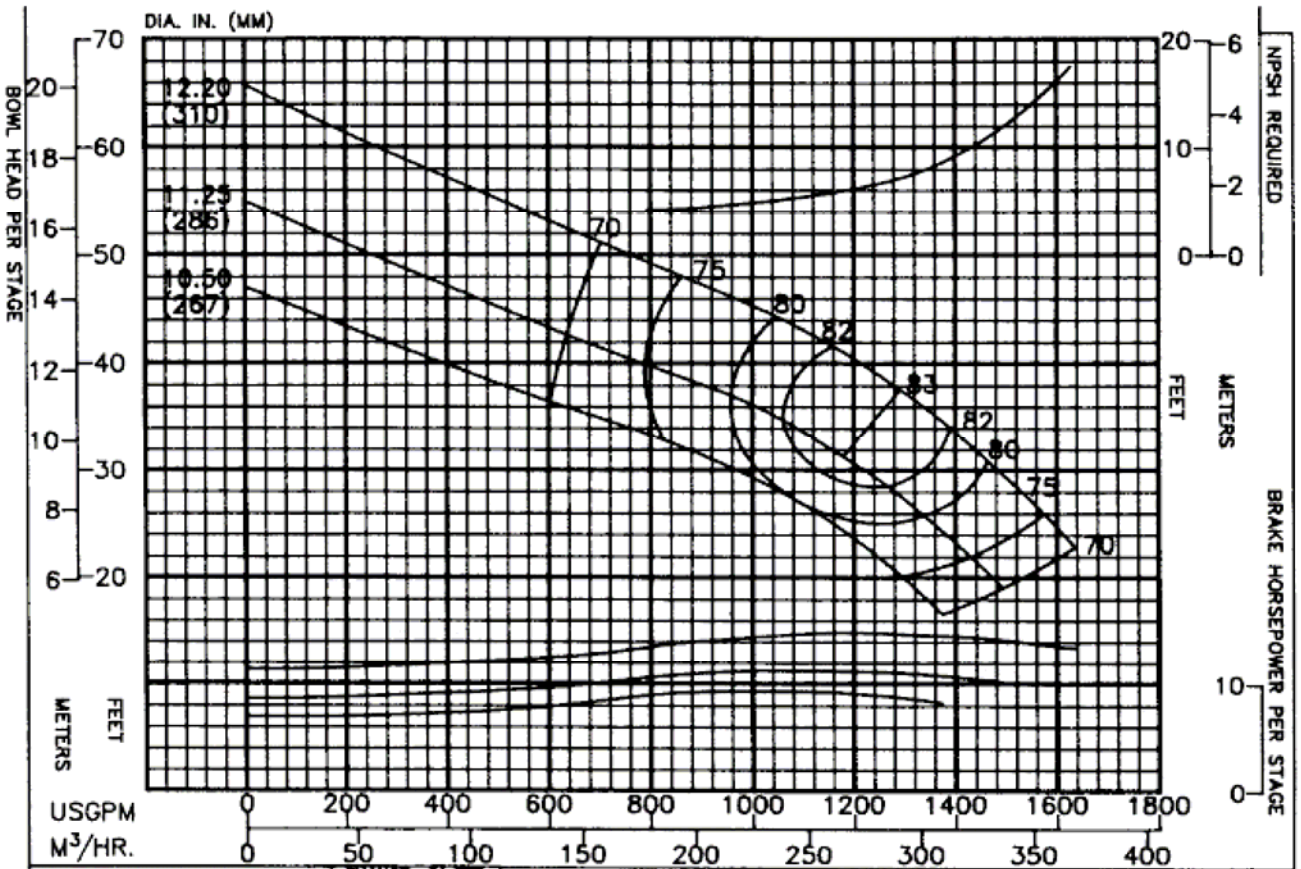

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN FT. POINTS
BOWL – CAST IRON – LINED	2	-2
IMPELLER – BRONZE	3	0

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	12.7	18.9
BALANCED	4.5	6.7
EYE AREA–31.3 SQ. IN.		

RPM 1175
ENCLOSED IMPELLER
N_s = 2780

PUMP 16KKL
CURVE NO. EC–1445