APW - VERTICAL PUMPS

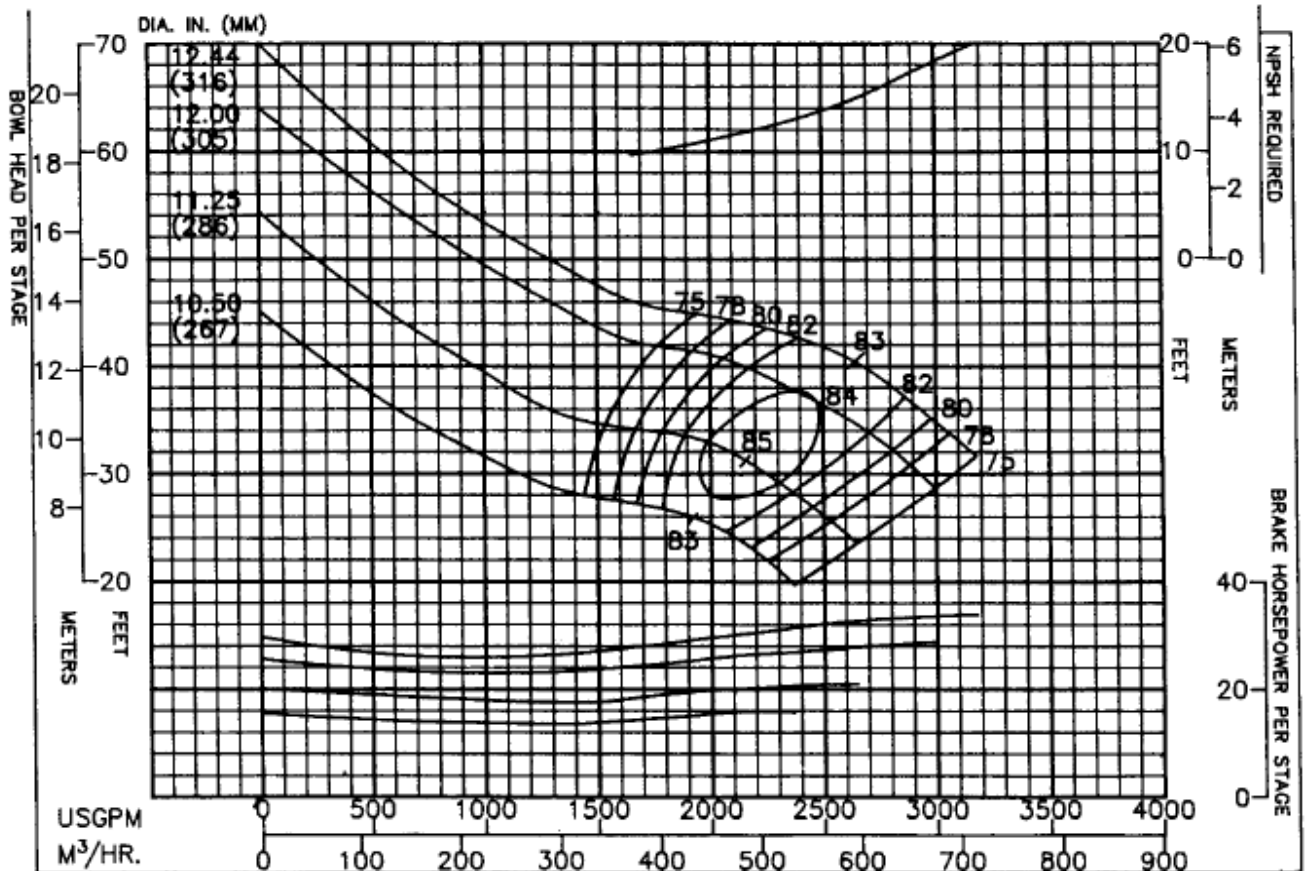

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE IN EFF. STAGES	POINTS
BOWL – CAST IRON – LINED	1	-2
IMPELLER – BRONZE	2	-1
	3	0

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP	LBS/FT	KG/M
IMPELLER		
STANDARD	16.4	24.5
BALANCED	11.1	16.5
EYE AREA–46.3 SQ. IN.		

RPM	PUMP
1175	16NKH
ENCLOSED IMPELLER	CURVE NO.
N_s = 3780	EC–1380