APW - VERTICAL PUMPS

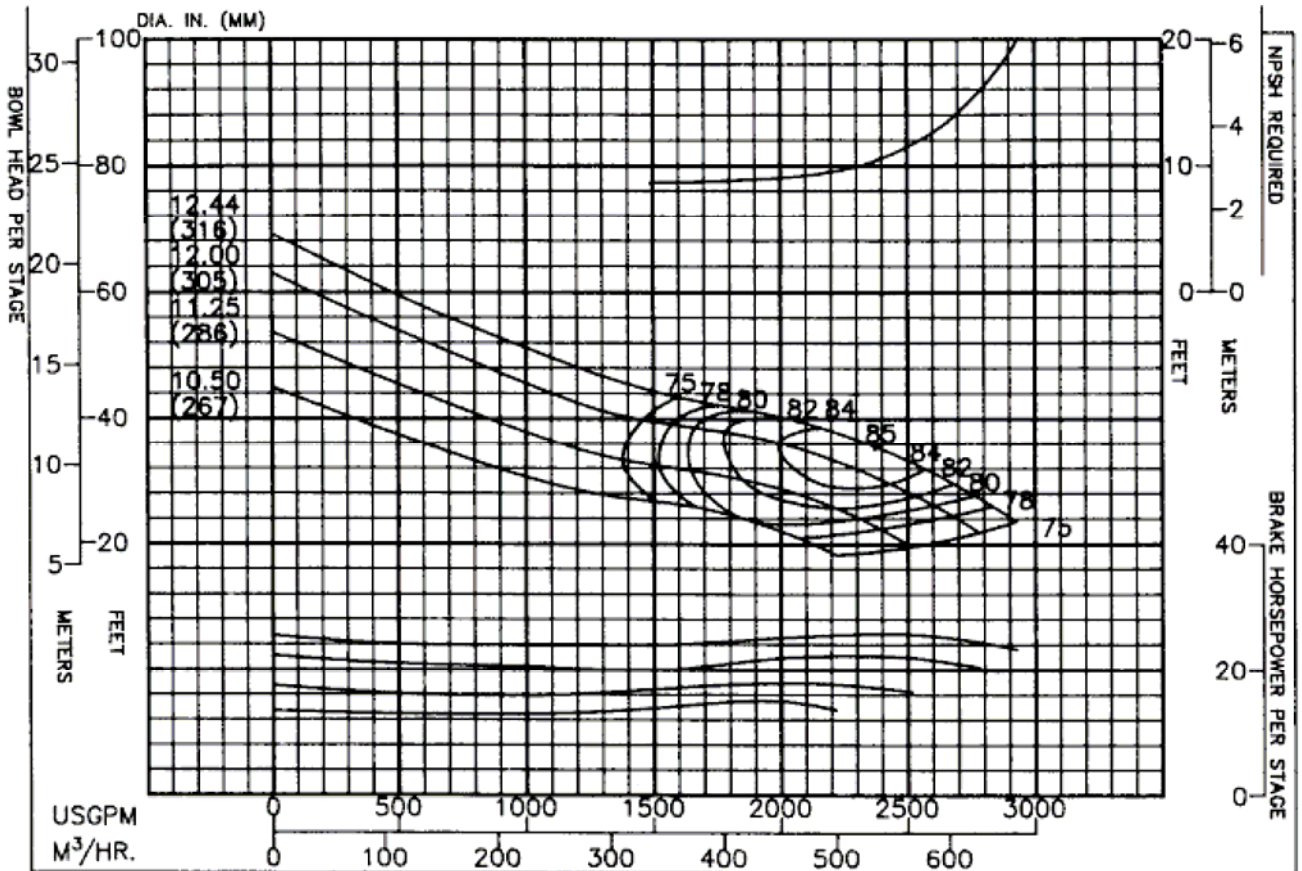

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE IN FT. STAGES	POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP: IMPELLER LBS/FT KG/M; STANDARD 17.2 25.7; BALANCED 11.1 16.5; EYE AREA-46.3 SQ. IN.	RPM 1175	PUMP 16NKL
BOWL – CAST IRON – LINED	1	-7			ENCLOSED IMPELLER	CURVE NO.
IMPELLER – BRONZE	2	-1			N_s = 3945	EC-1366
	3	0				