APW - VERTICAL PUMPS

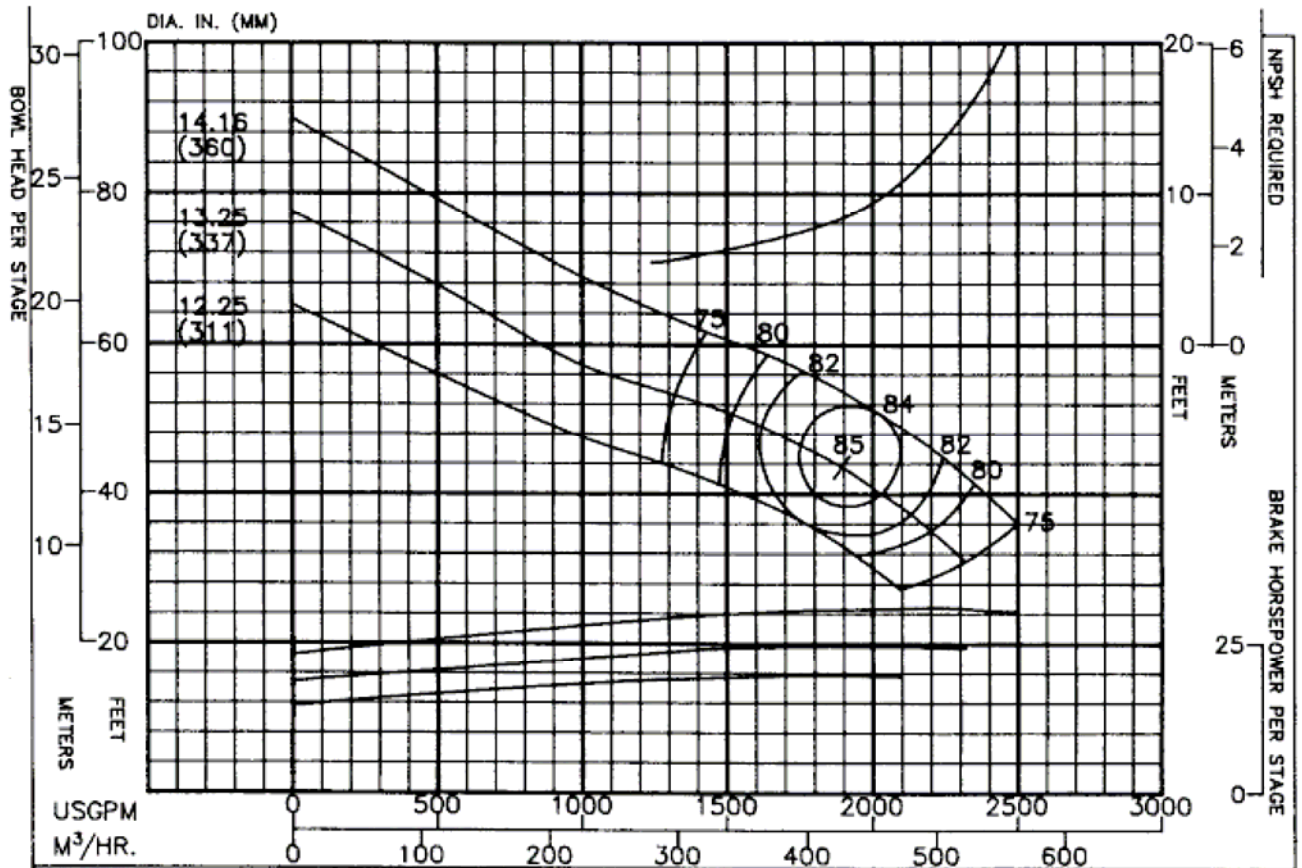

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP		RPM 1180	PUMP 18KKL
BOWL – CAST IRON – LINED	1	-1		IMPELLER	LBS/FT	KG/M	
IMPELLER – BRONZE	2	-2		STANDARD	16.3	24.3	
	3	0		BALANCED	5.8	8.7	ENCLOSED IMPELLER N_s = 2820
				EYE AREA–47.3 SQ. IN.			CURVE NO. EC–1446