APW - VERTICAL PUMPS

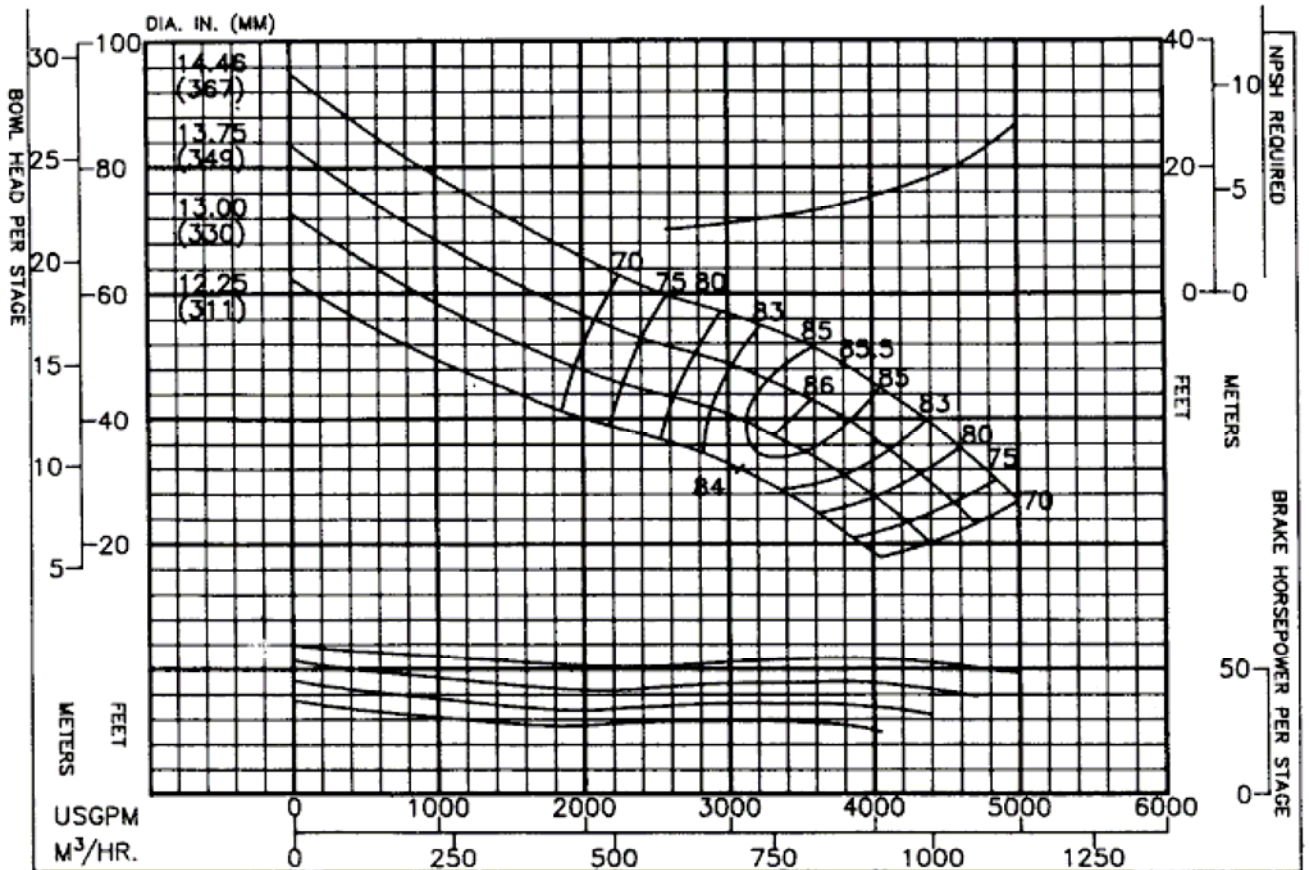

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW BST. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP: IMPELLER LBS/FT KG/M	RPM	PUMP
BOWL – CAST IRON – LINED	2	0		STANDARD 23.2 34.6	1180	18NKL
IMPELLER – BRONZE				BALANCED 15.7 23.4	ENCLOSED IMPELLER	CURVE NO.
				EYE AREA–82.4 SQ. IN.	N_s = 3930	EC--1454