APW - VERTICAL PUMPS

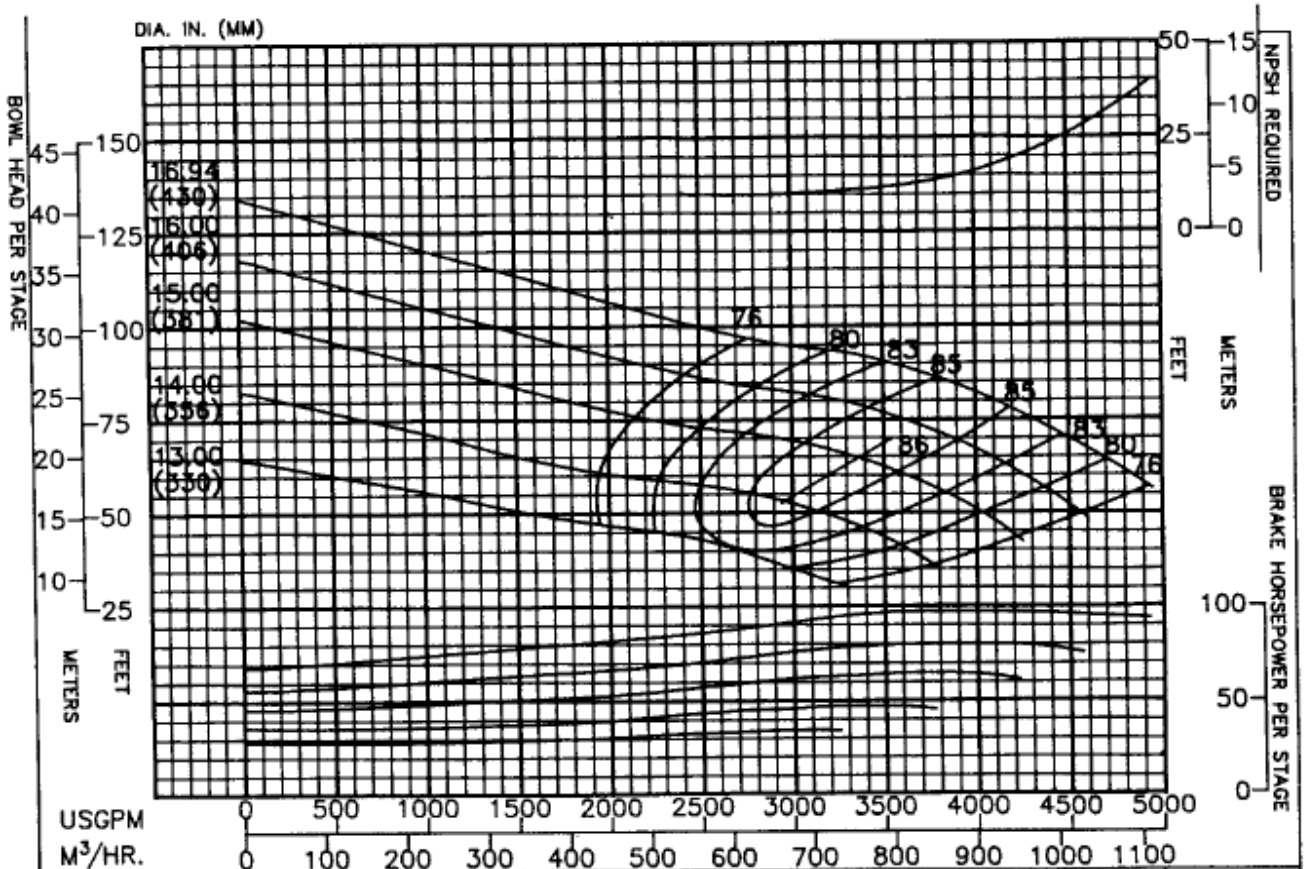

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS
	1	2
	2	1
BOWL – CAST IRON – LINED	3	0
IMPELLER – BRONZE		

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	19.7	29.3
BALANCED	10.0	14.9
EYE AREA–60.5 SQ. IN.		

RPM	PUMP
1180	20KKH
ENCLOSED IMPELLER	CURVE NO.
N_s = 2740	EC–1362