APW - VERTICAL PUMPS

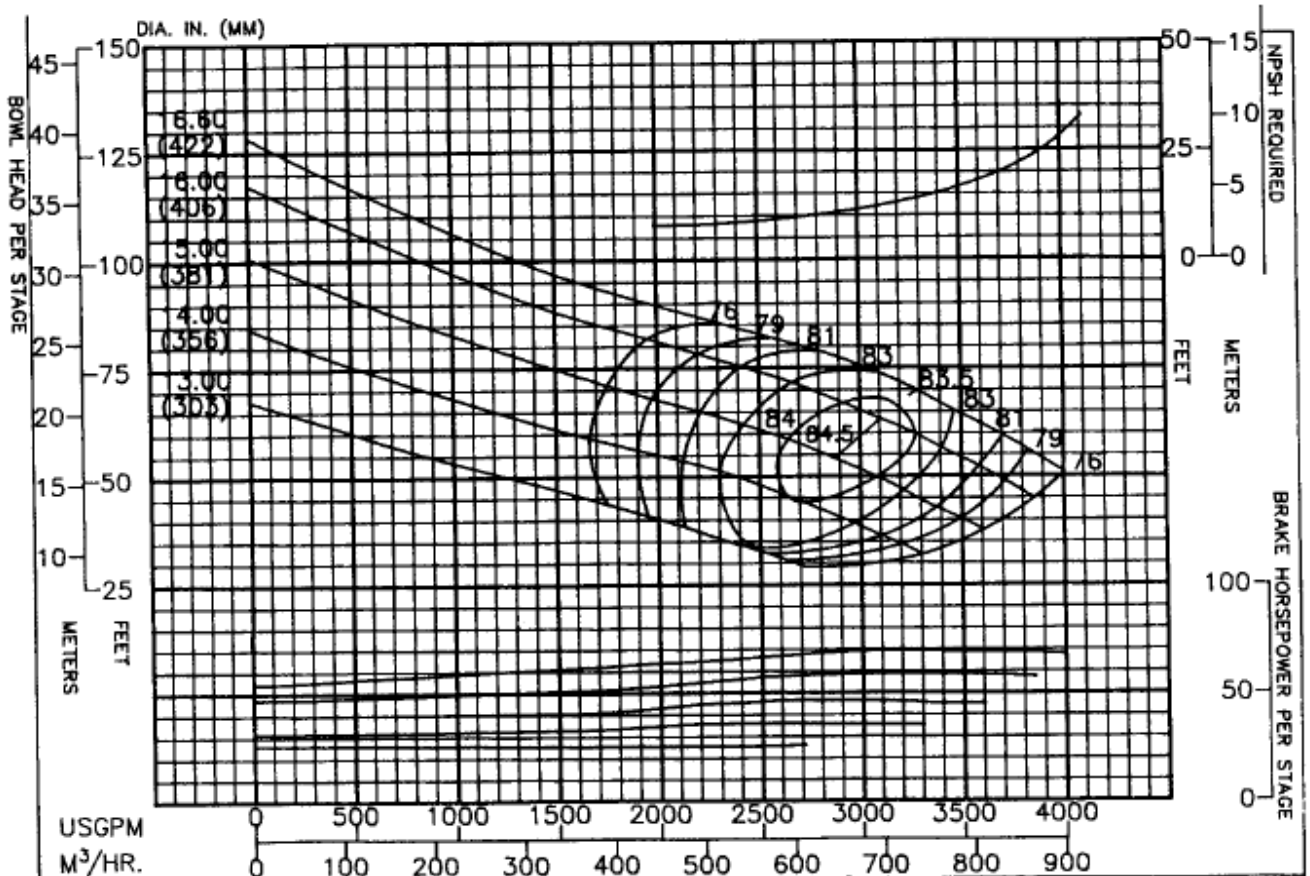

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS
BOWL – CAST IRON – LINED	1	−2
IMPELLER – BRONZE	2	−1
	3	0

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	21.1	31.4
BALANCED	9.9	14.8
EYE AREA–60.5 SQ. IN.		

RPM	PUMP
1180	20KKL
ENCLOSED IMPELLER	CURVE NO.
N_s = 2800	EC–1368