APW - VERTICAL PUMPS

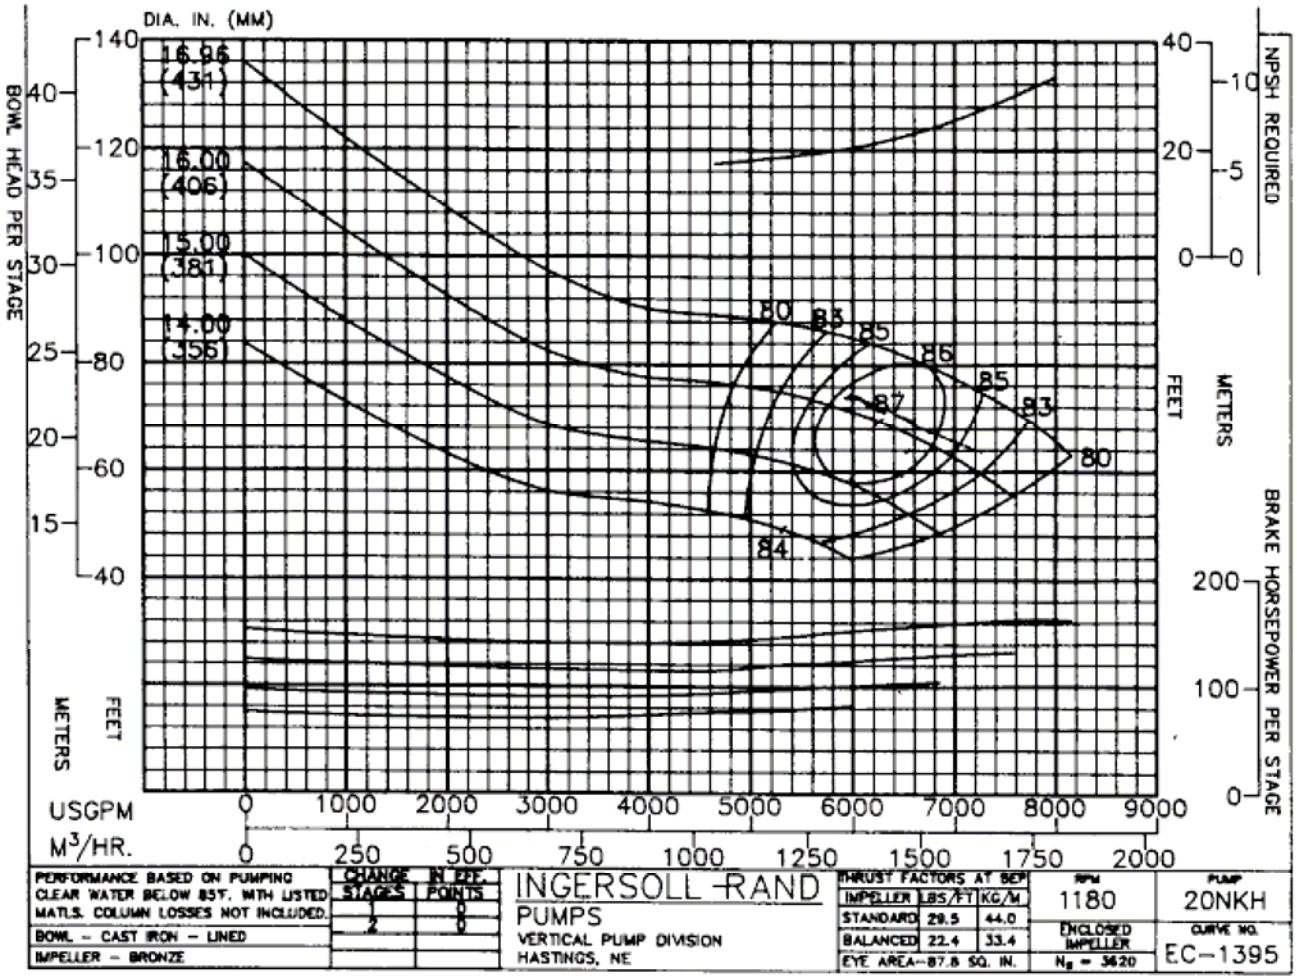

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP			RPM	PUMP
	1	0		IMPELLER	LBS/FT	KG/M	1180	20NKH
	2	0		STANDARD	29.5	44.0		
BOWL – CAST IRON – LINED				BALANCED	22.4	33.4	ENCLOSED IMPELLER	CURVE NO.
IMPELLER – BRONZE				EYE AREA–87.8 SQ. IN.			N_s = 3620	EC–1395