APW - VERTICAL PUMPS

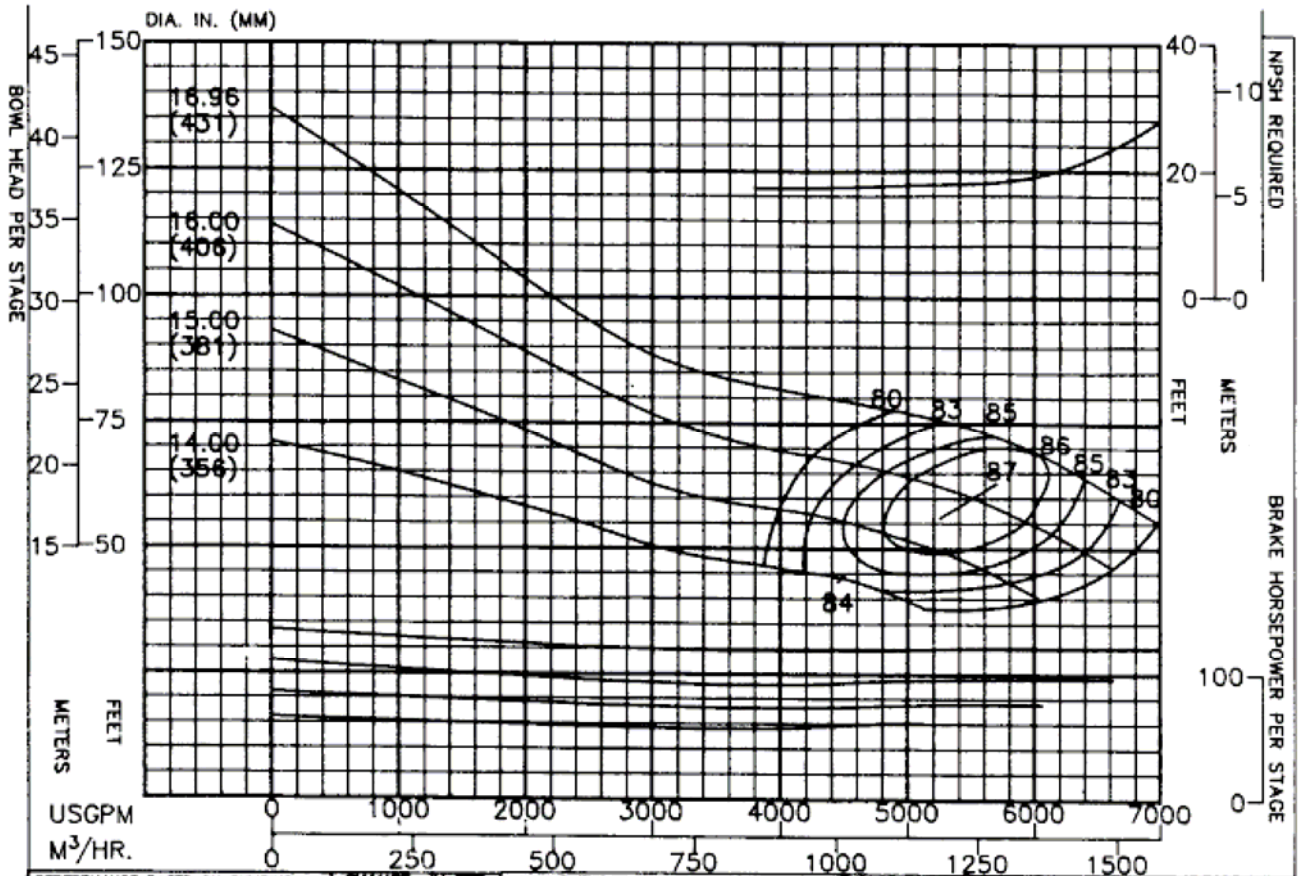

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE IN PER. STAGES	CHANGE IN PER. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP		RPM	PUMP
BOWL – CAST IRON – LINED	1	0		IMPELLER LBS/FT	KG/M	1180	20NKL
IMPELLER – BRONZE	2	0		STANDARD 31.0	46.2	ENCLOSED IMPELLER	CURVE NO.
				BALANCED 22.4	33.4		EC-1397
				EYE AREA–87.8 SQ. IN.		N_s = 3630	