APW - VERTICAL PUMPS

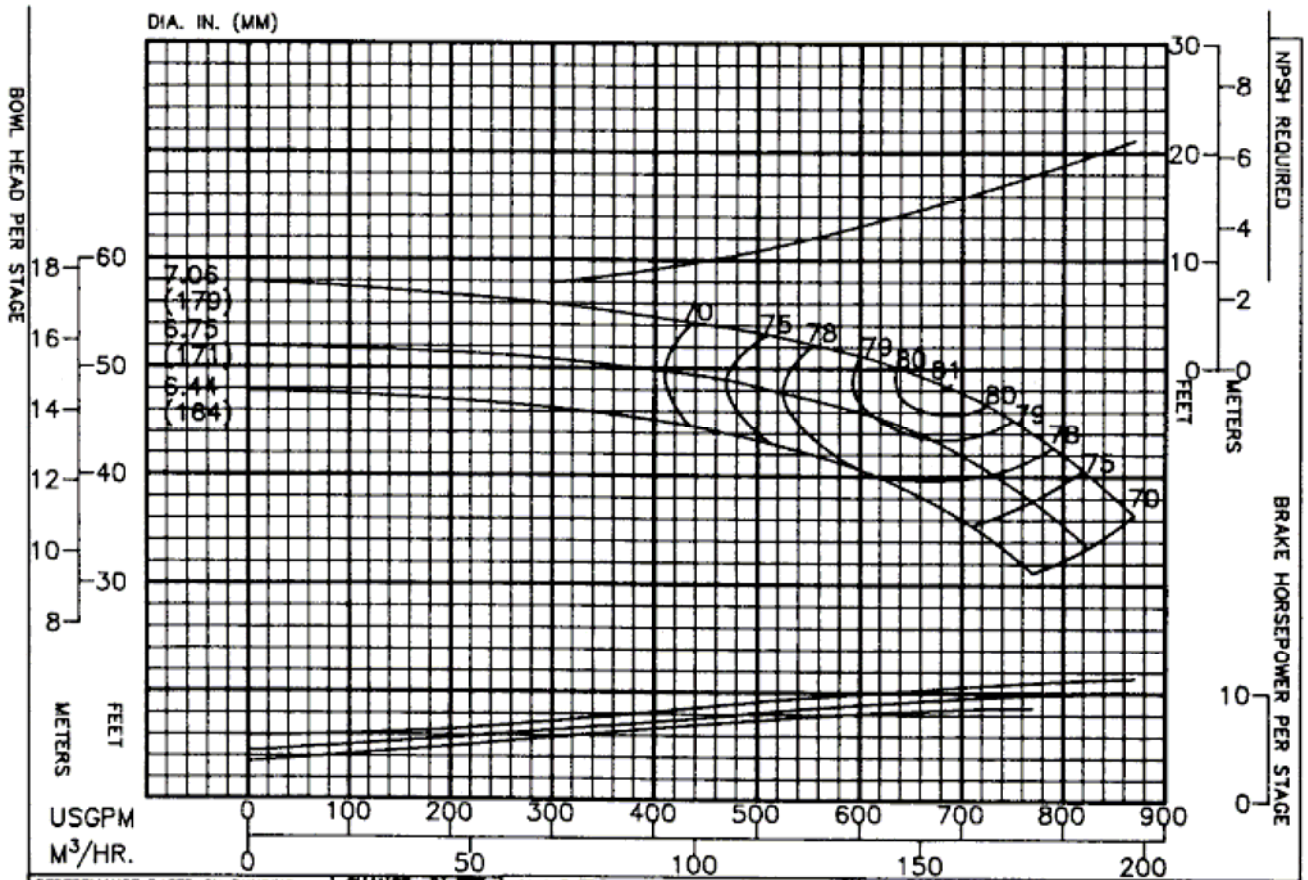

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE IN STAGES	CHANGE IN EFF. POINTS
BOWL – CAST IRON	1	-3
IMPELLER – BRONZE	2	-5
	3	-6

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	7.5	11.2
BALANCED	---	---
EYE AREA–12.4 SQ. IN.		

RPM	PUMP
1770	10CH
SEMI-OPEN IMPELLER	CURVE NO.
N_s = 2750	EC–1472