APW - VERTICAL PUMPS

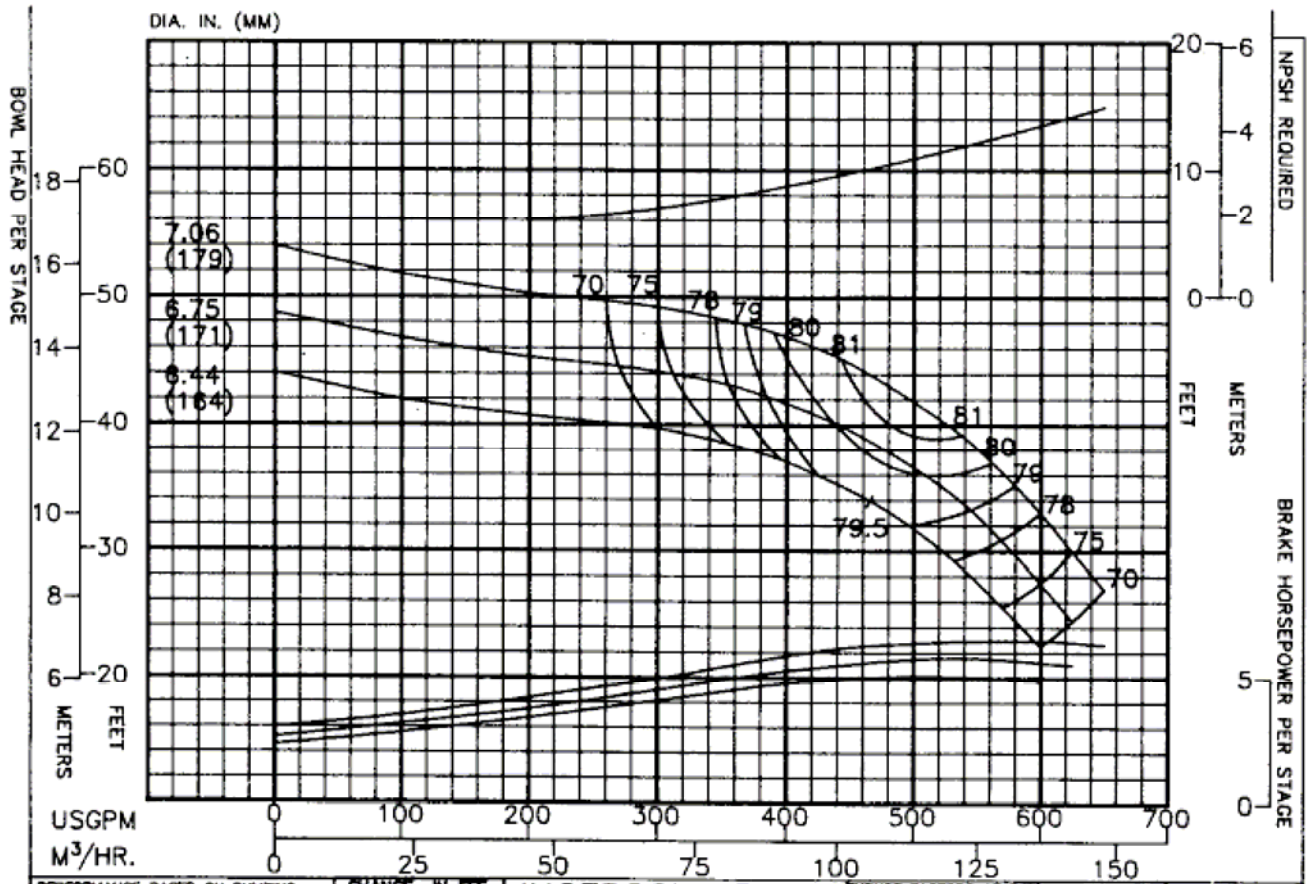

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE IN EFF. STAGES	POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP: IMPELLER LBS/FT KG/M; STANDARD 7.7 11.5; BALANCED --- ---	RPM 1770	PUMP 10CM
BOWL – CAST IRON	2	-3		EYE AREA–12.4 SQ. IN.	SEMIOPEN IMPELLER N_s = 2385	CURVE NO. EC–1471
IMPELLER – BRONZE	3	0				