APW - VERTICAL PUMPS

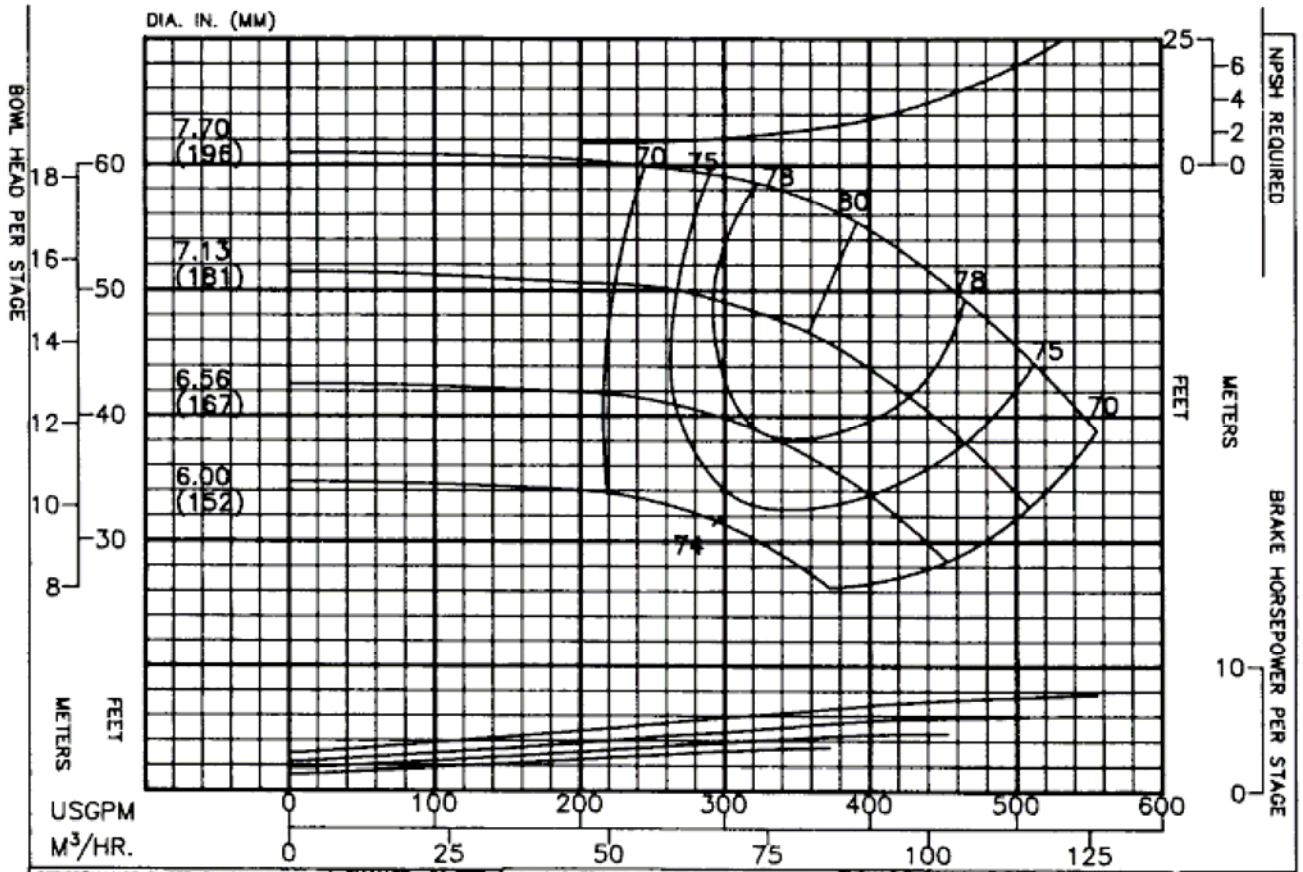

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS
BOWL – CAST IRON – LINED	1	−1
IMPELLER – BRONZE	2	−1½
	3	−1½
	4	0

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	3.1	4.6
BALANCED	2.5	3.7
EYE AREA – 8.64 SQ. IN.		

RPM	PUMP
1770	10JKH
ENCLOSED IMPELLER N_s = 1720	CURVE NO. EC–1476