APW - VERTICAL PUMPS

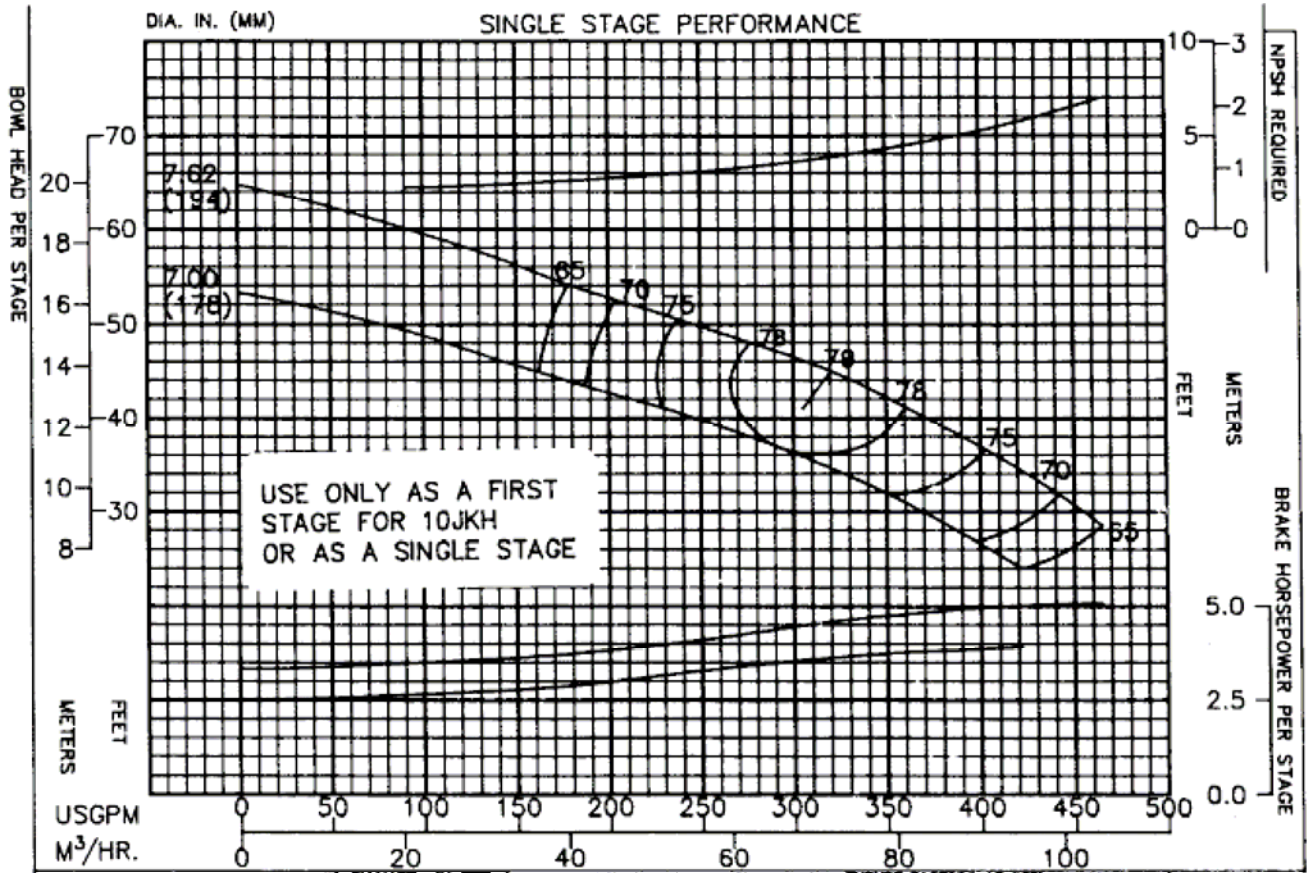

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES 1	IN EFF. POINTS 0	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP		RPM 1770	PUMP 10JKYH
BOWL – CAST IRON – LINED				IMPELLER	LBS/FT	KG/M	
IMPELLER – BRONZE				STANDARD	4.3	6.4	
				BALANCED	--	--	ENCLOSED IMPELLER
				EYE AREA–13.3 SQ. IN.		N_s = 1820	CURVE NO. EC–1425