APW - VERTICAL PUMPS

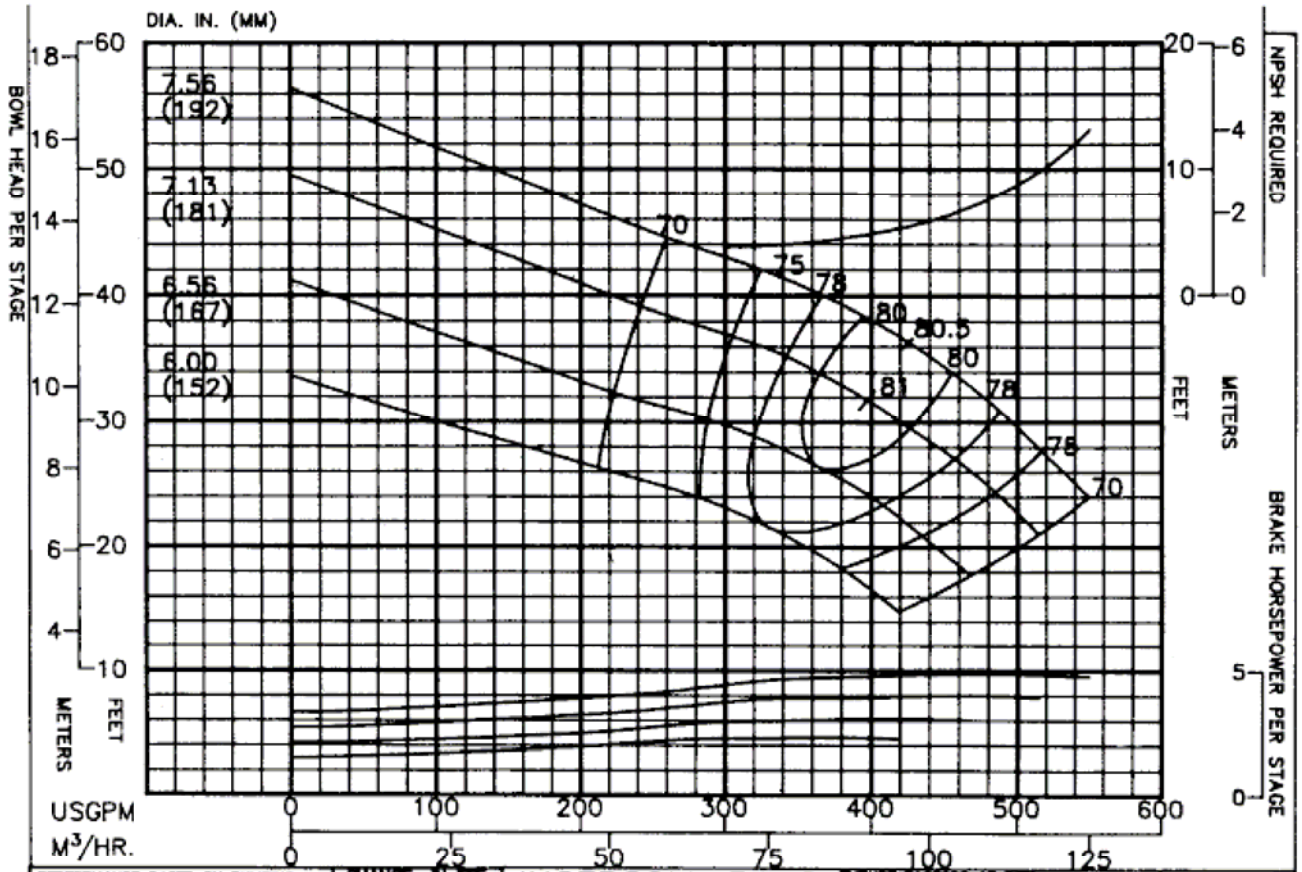

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	% DIA. POINTS
BOWL – CAST IRON – LINED	1	-1
IMPELLER – BRONZE	2	-2
	3	0

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	5.2	7.8
BALANCED	2.4	3.6
EYE AREA–11.7 SQ. IN.		

RPM	PUMP
1770	10KKL
ENCLOSED IMPELLER N_s = 2460	CURVE NO. EC–1458