


Dated July 27, 1990

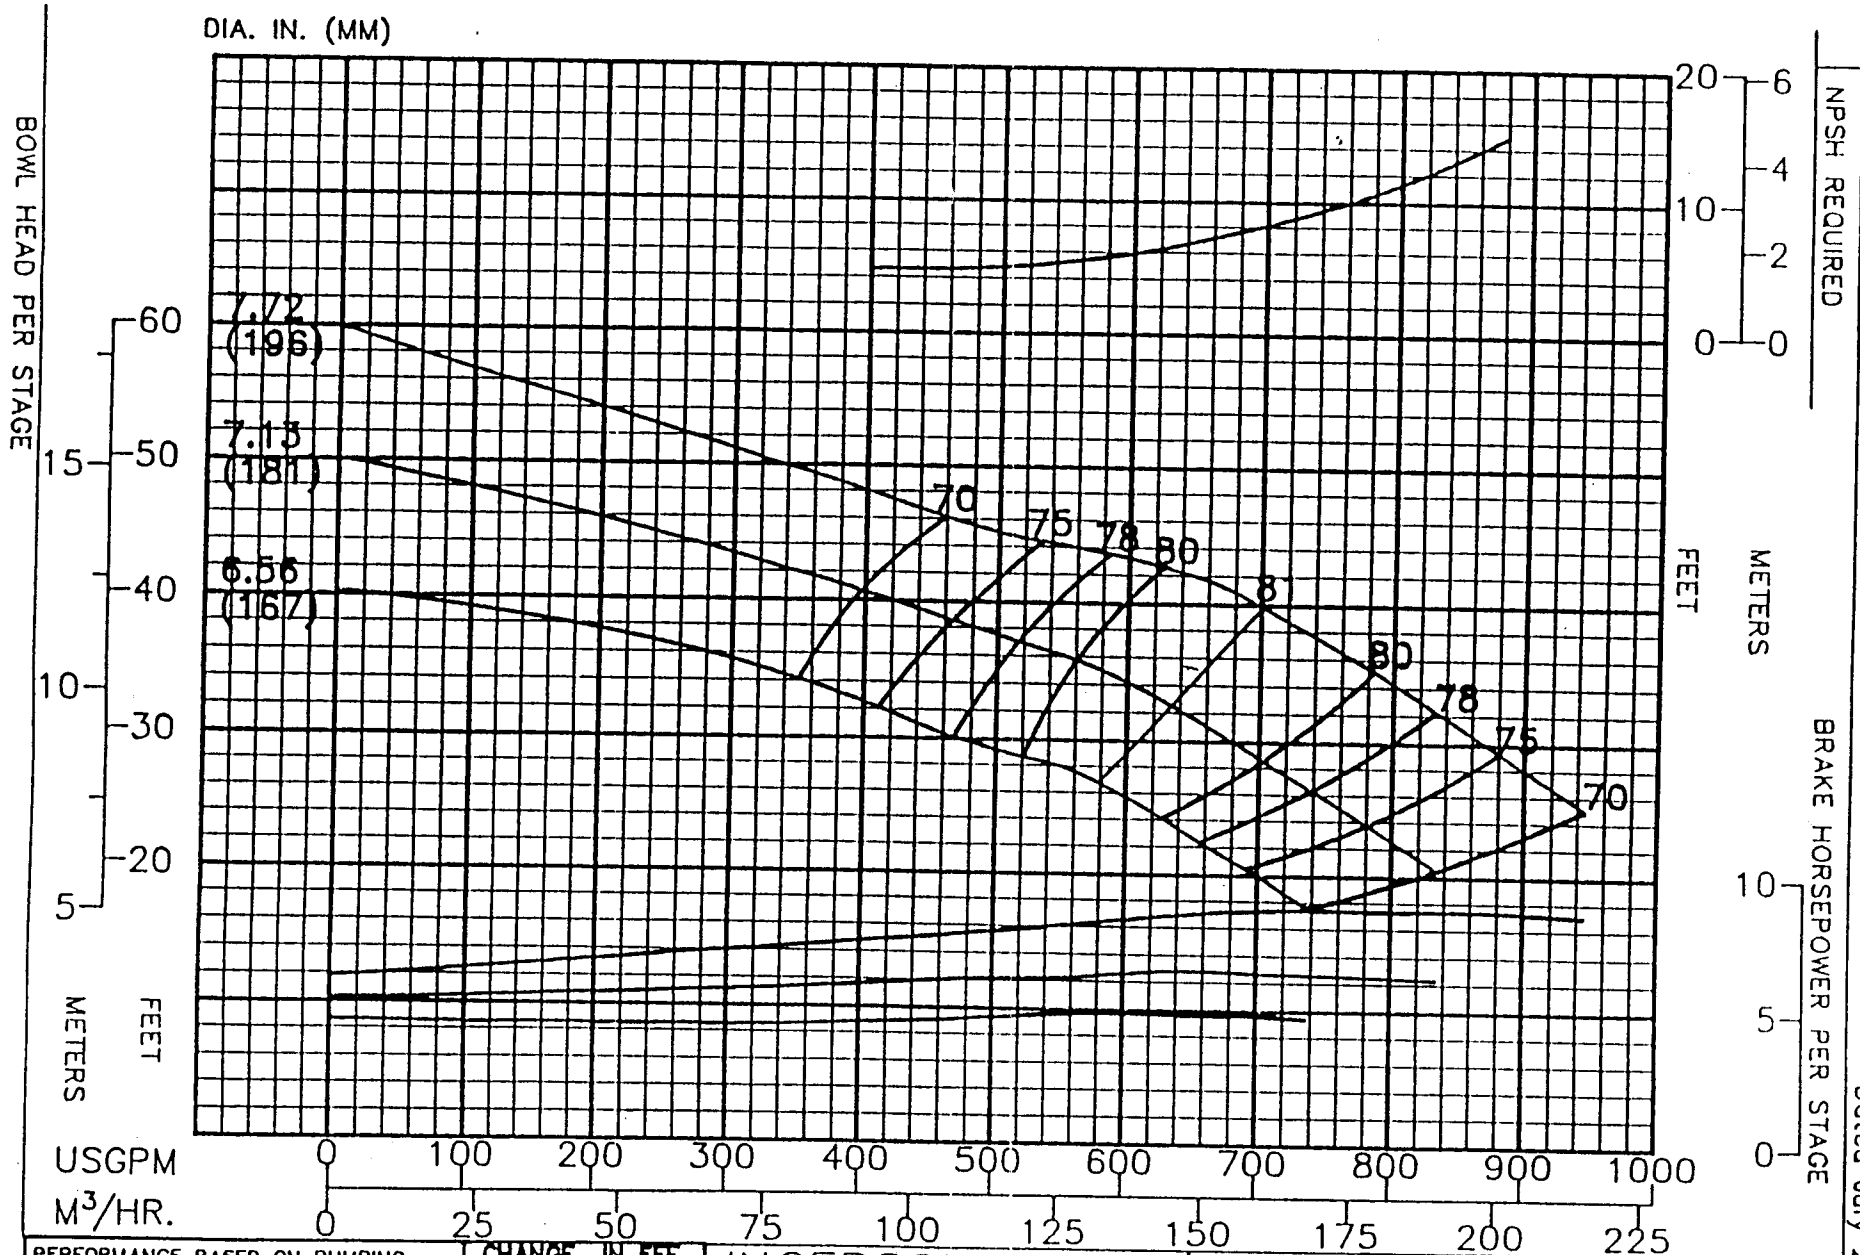

PERFORMANCE BASED ON PUMPING
CLEAR WATER BELOW 85°F. WITH LISTED
MATS. COLUMN LOSSES NOT INCLUDED.

BOWL - CAST IRON - LINED
IMPELLER - BRONZE

CHANGE	IN	FEET
STAGES	POINTS	
1	2	
3	0	

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	6.1	9.1
BALANCED	3.1	4.6
EYE AREA-15.7 SQ. IN.		

RPM	1770
ENCLOSED IMPELLER	
N _s = 2960	

PUMP	10LKH
CURVE NO.	EC-1595