


Dated October 8, 1990

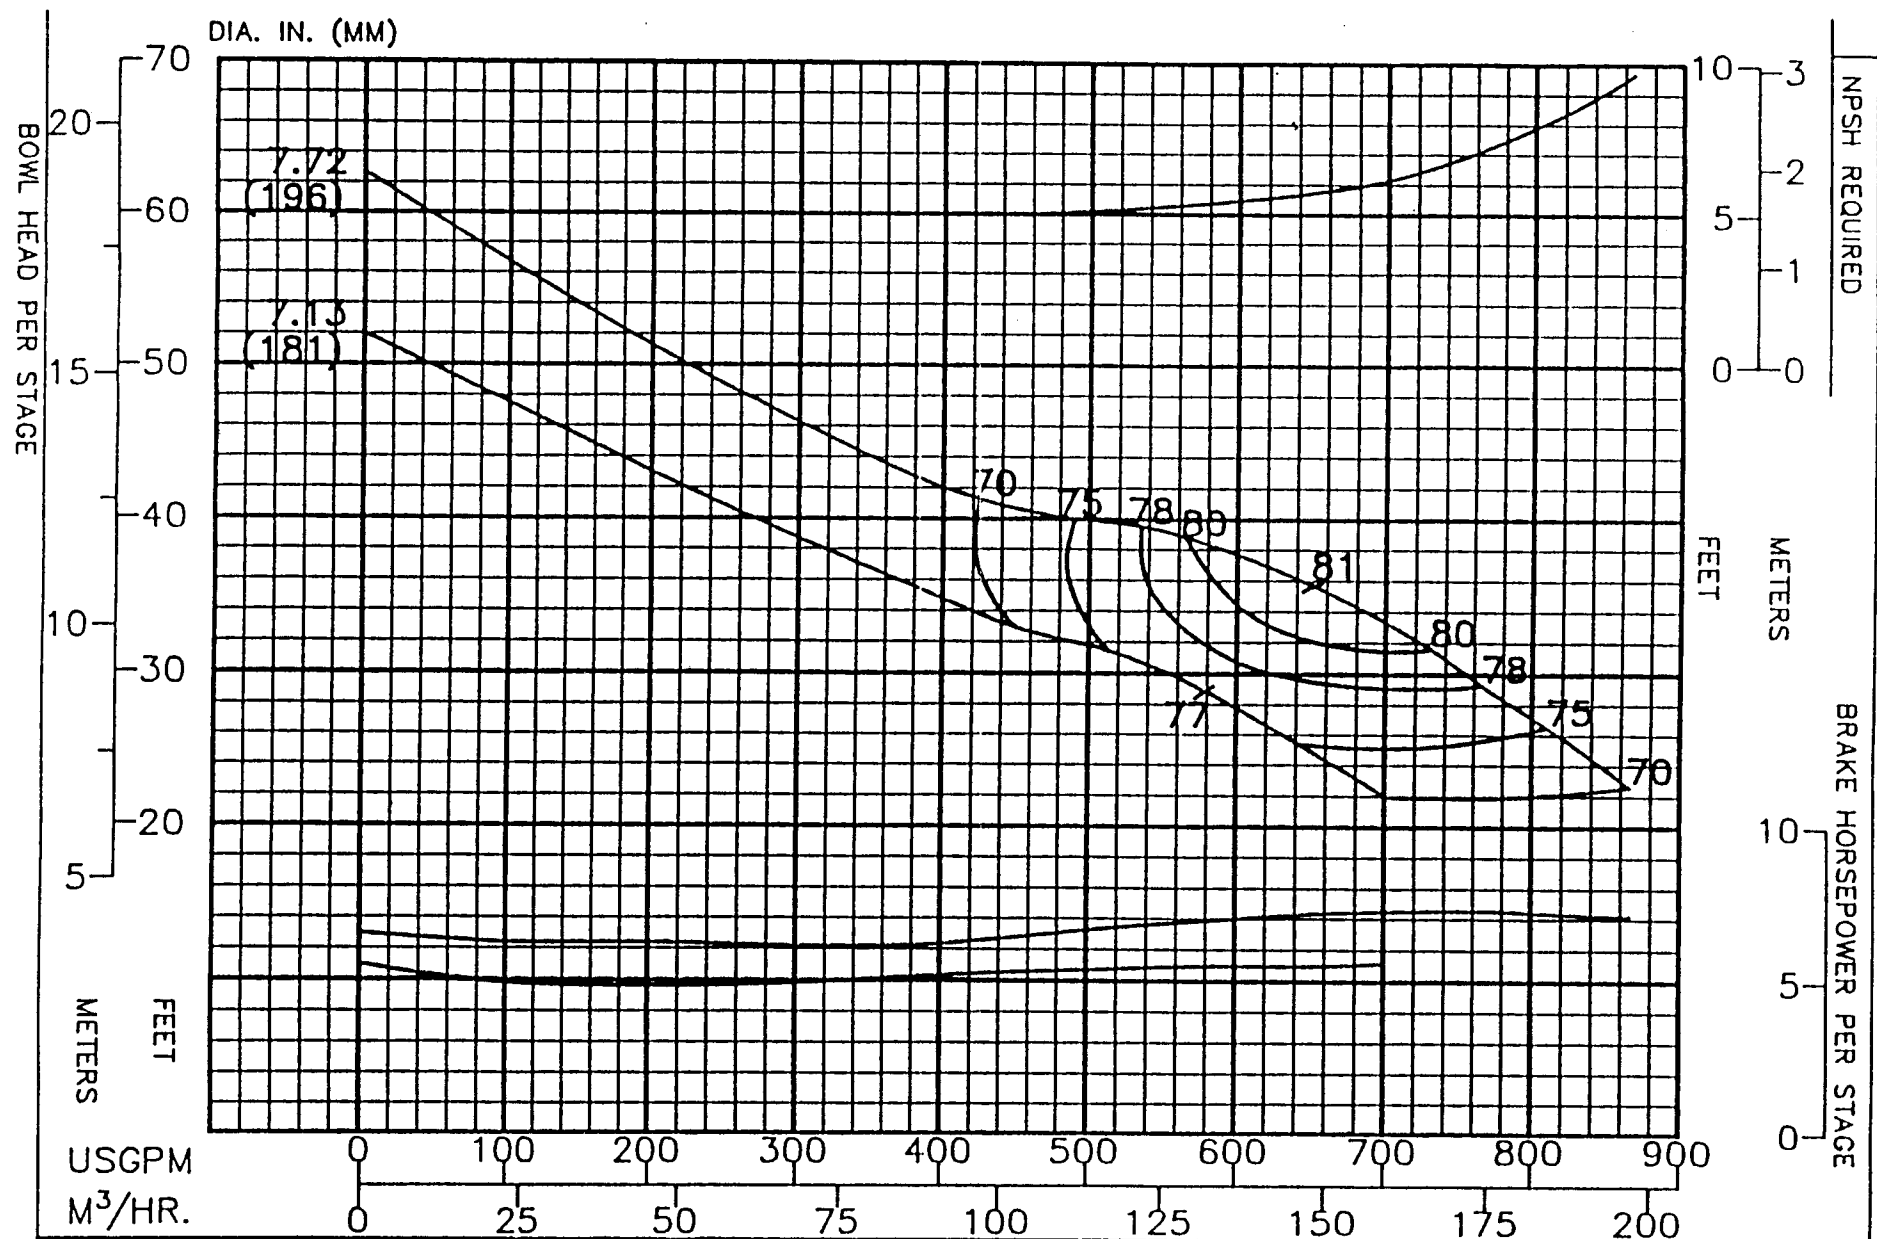

PERFORMANCE BASED ON PUMPING
CLEAR WATER BELOW 85°F. WITH LISTED
MATS. COLUMN LOSSES NOT INCLUDED.

BOWL - CAST IRON - LINED
IMPELLER - BRONZE

CHANGE IN EFF.	
STAGES	POINTS
1	0

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	7.6	11.4
BALANCED	---	---
EYE AREA-20.0 SQ. IN.		

RPM
1770
ENCLOSED
IMPELLER
N_s = 3030

PUMP
10LK YH
CURVE NO.
EC-1677