APW - VERTICAL PUMPS

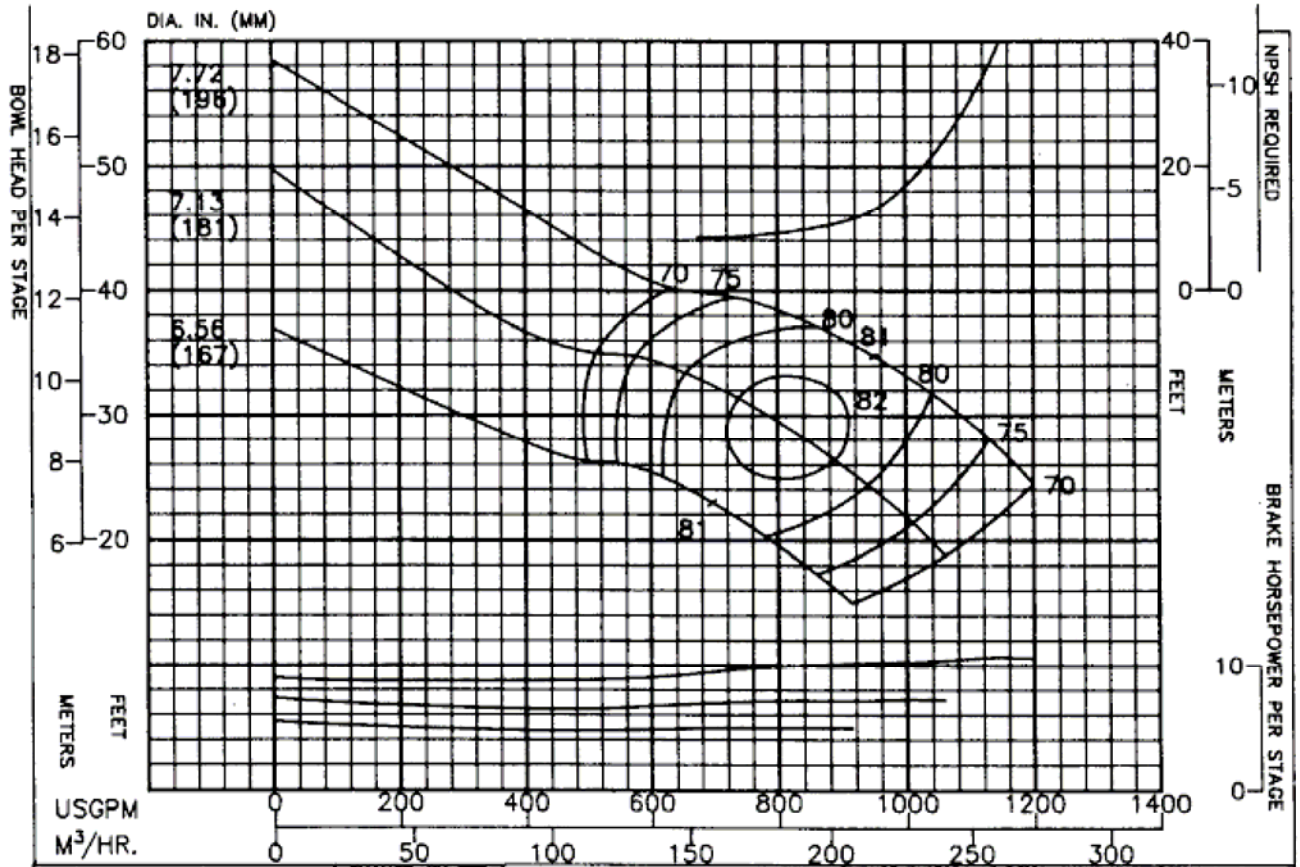

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE IN EFF. STAGES / POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP: IMPELLER LBS/FT KG/M; STANDARD 7.3 10.9; BALANCED 6.0 8.9; EYE AREA-17.2 SQ. IN.	RPM 1770	PUMP 10NKH
BOWL – CAST IRON – LINED	2 -4			ENCLOSED IMPELLER	CURVE NO.
IMPELLER – BRONZE	3 -1			Ns 3810	EC-1441
	5 0				