APW - VERTICAL PUMPS

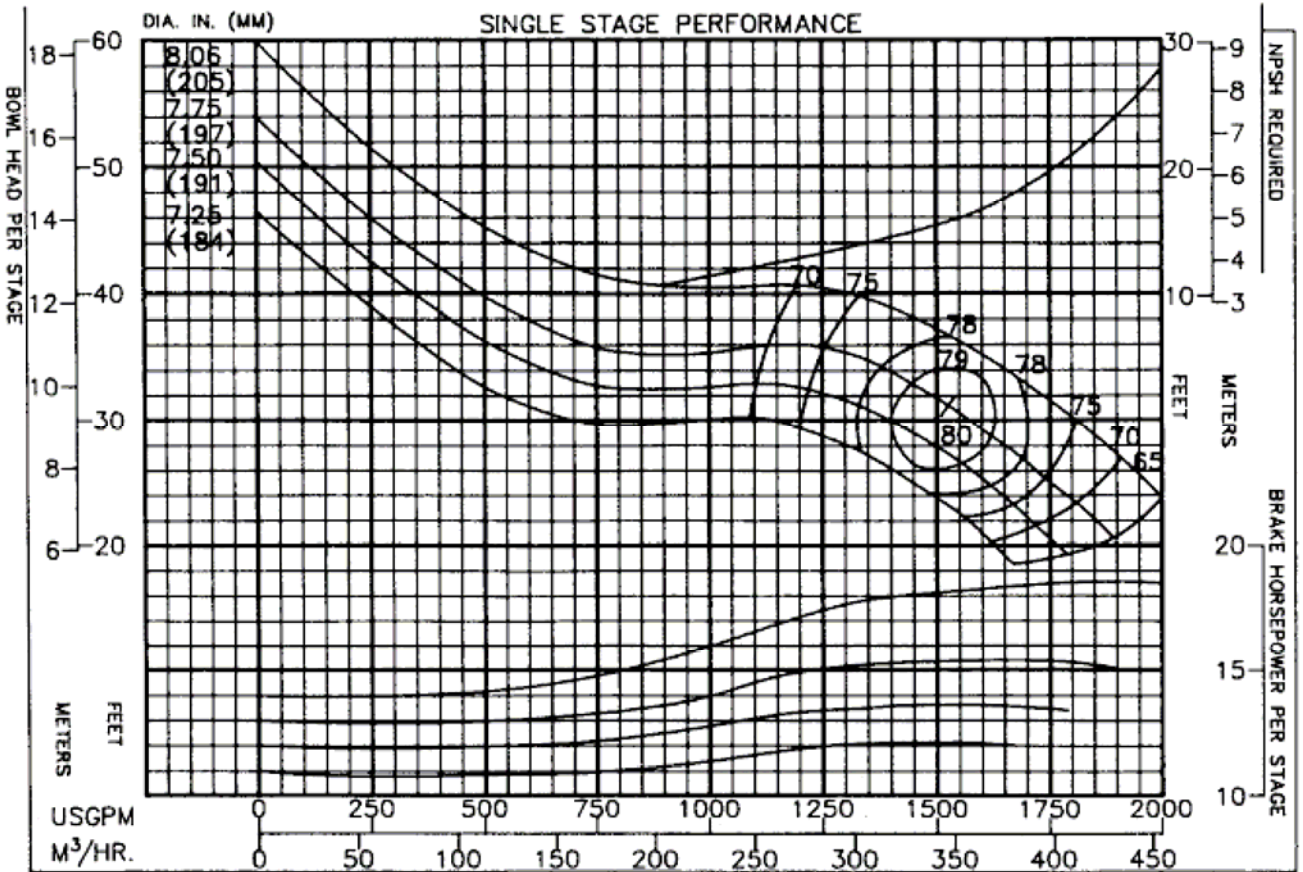

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE IN EFF. STAGES	POINTS
	1	0
BOWL – CAST IRON – LINED		
IMPELLER – BRONZE		

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	11.0	16.4
BALANCED	---	---
EYE AREA–26.0 SQ. IN.		

RPM	PUMP
1770	10QKH
ENCLOSED IMPELLER	CURVE NO.
N_{ss} = 4910	EC–1465