APW - VERTICAL PUMPS

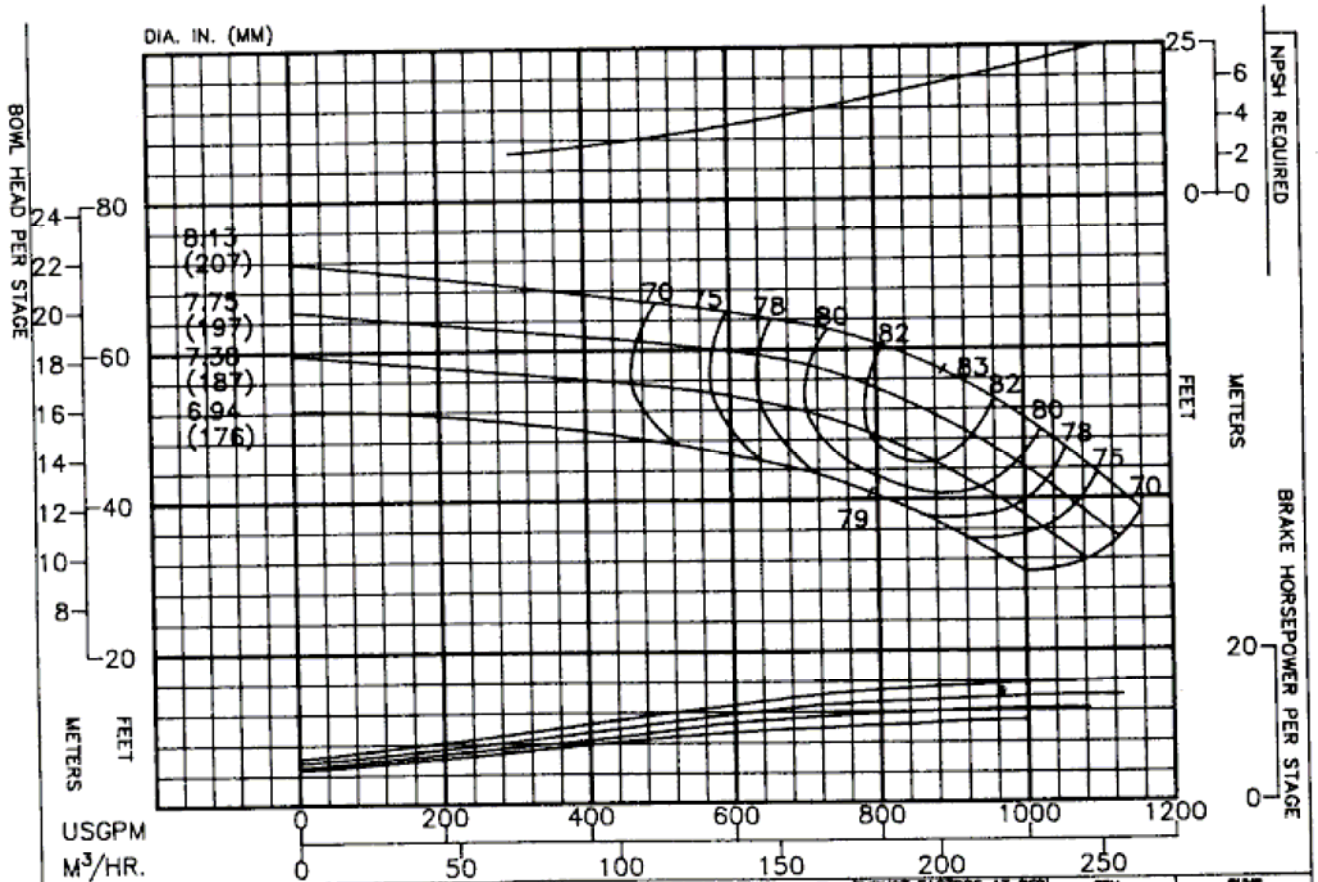

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP: IMPELLER LBS/FT / KG/M	RPM 1770	PUMP 12CH
BOWL – CAST IRON	1	−2		STANDARD 12.5 / 18.6	SEMIOPEN IMPELLER	CURVE NO.
IMPELLER – BRONZE	2	0		BALANCED ---- / ----	N_s = 2514	EC–1474
				EYE AREA–16.0 SQ. IN.		