APW - VERTICAL PUMPS

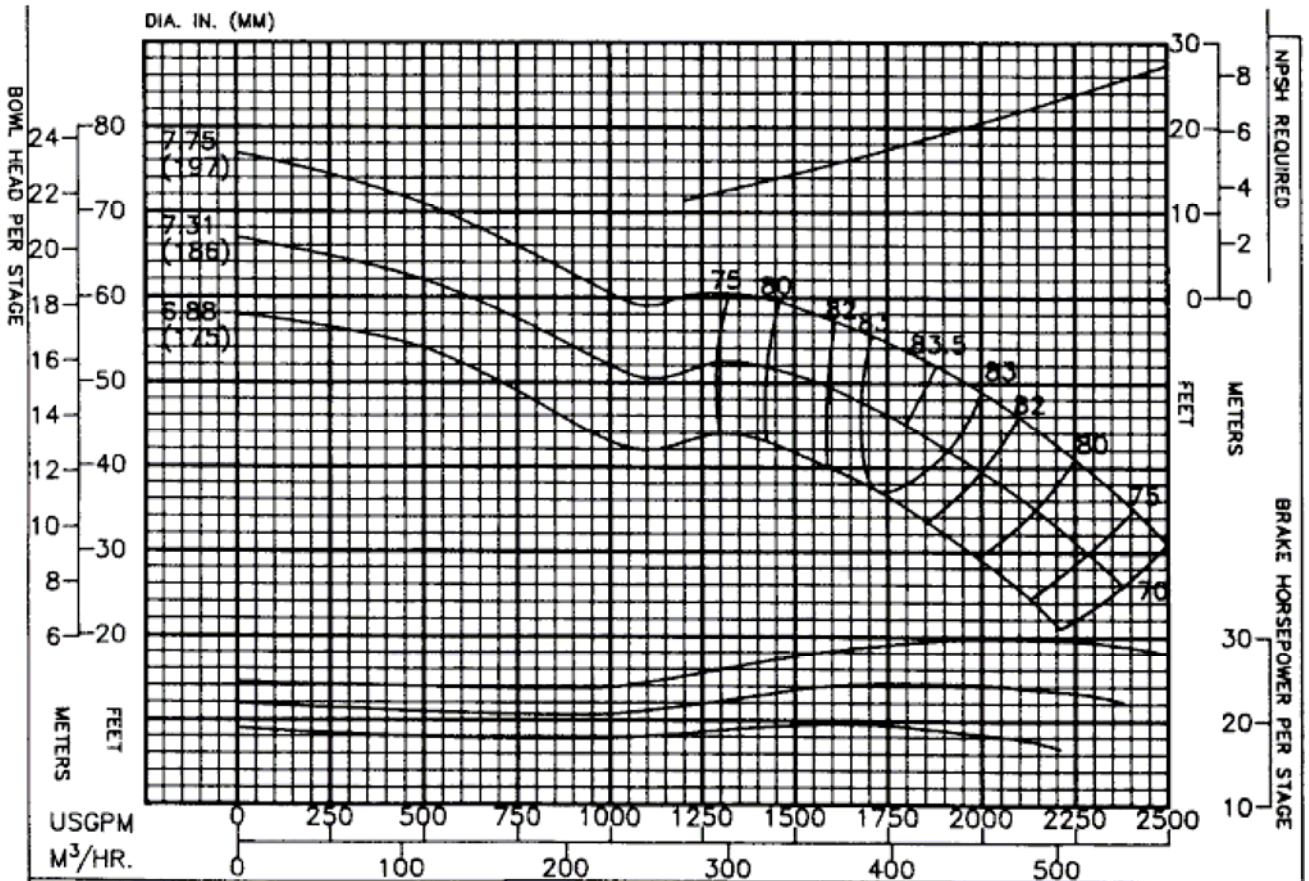

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE IN EFF. STAGES	POINTS
BOWL – CAST IRON	1	-2
IMPELLER – BRONZE	2	-1
	3	0

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	23.0	34.3
BALANCED	---	---
EYE AREA–33.4 SQ. IN.		

RPM	PUMP
1770	12DH
SEMI-OPEN IMPELLER	CURVE NO.
N_s = 3940	EC–1475