APW - VERTICAL PUMPS

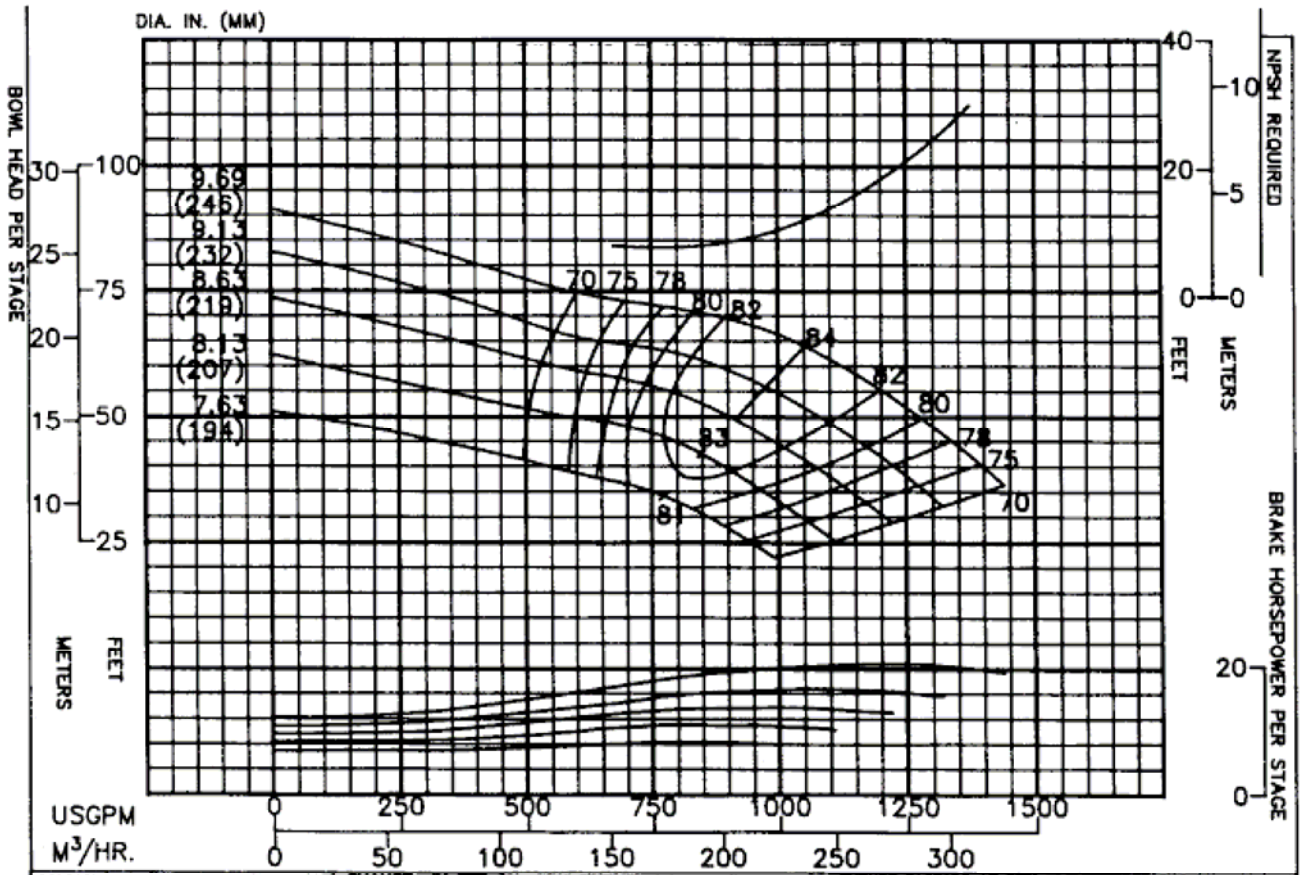

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN PER POINTS
BOWL – CAST IRON – LINED	2	-1½
IMPELLER – BRONZE	3	-1
	4	-½
	5	0

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	7.0	10.4
BALANCED	4.4	6.6
EYE AREA–19.0 SQ. IN.		

RPM	PUMP
1770	12KKH
ENCLOSED IMPELLER	CURVE NO.
N_s = 2535	EC–1383