APW - VERTICAL PUMPS

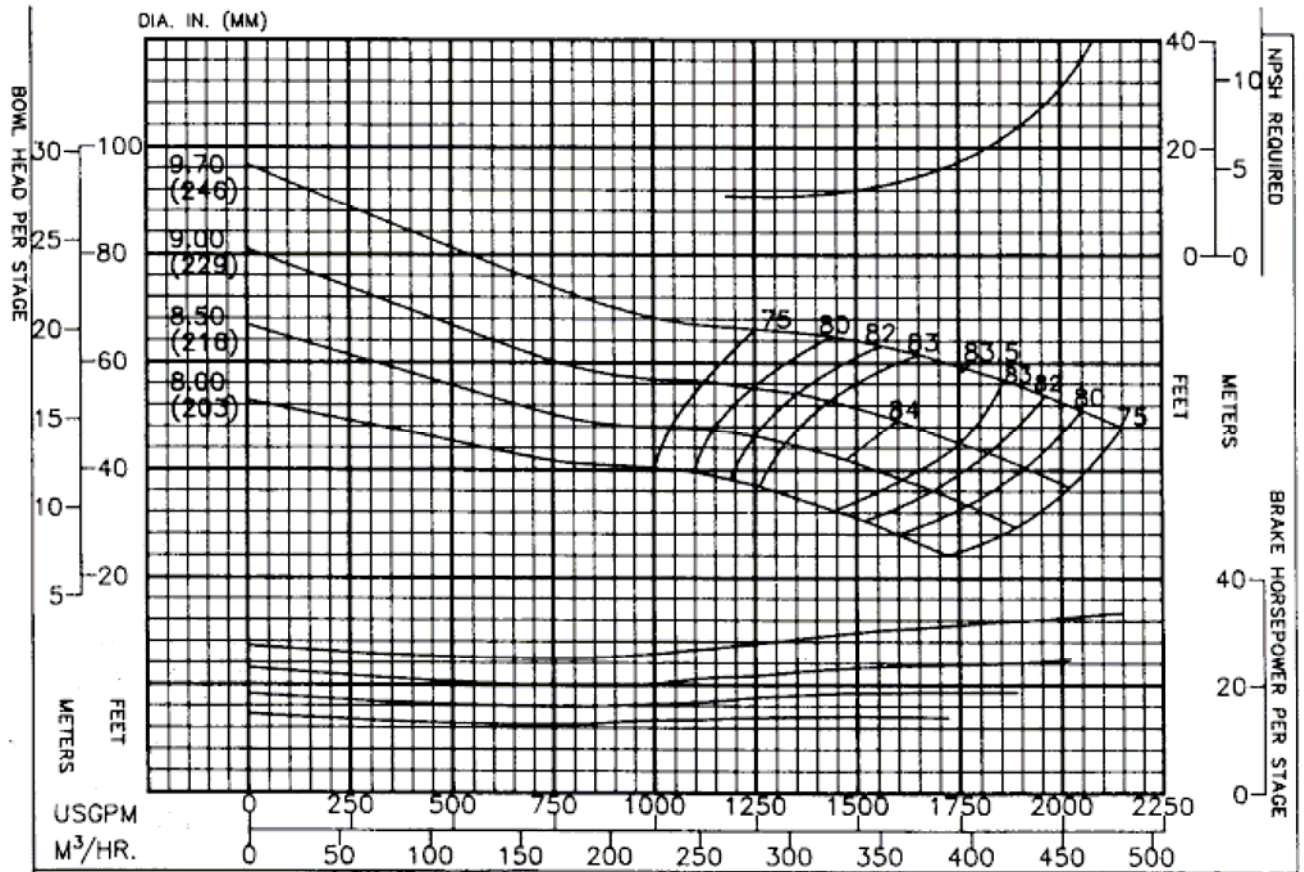

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP		RPM	PUMP
BOWL – CAST IRON – LINED	2	-2		IMPELLER	LBS/FT	KG/M	1770	12NKH
IMPELLER – BRONZE	3	-1		STANDARD	11.0	16.4	ENCLOSED IMPELLER	CURVE NO.
	3	0		BALANCED	9.0	13.3		EC-1390
				EYE AREA-27.8 SQ. IN.			N_s = 3490	