APW - VERTICAL PUMPS

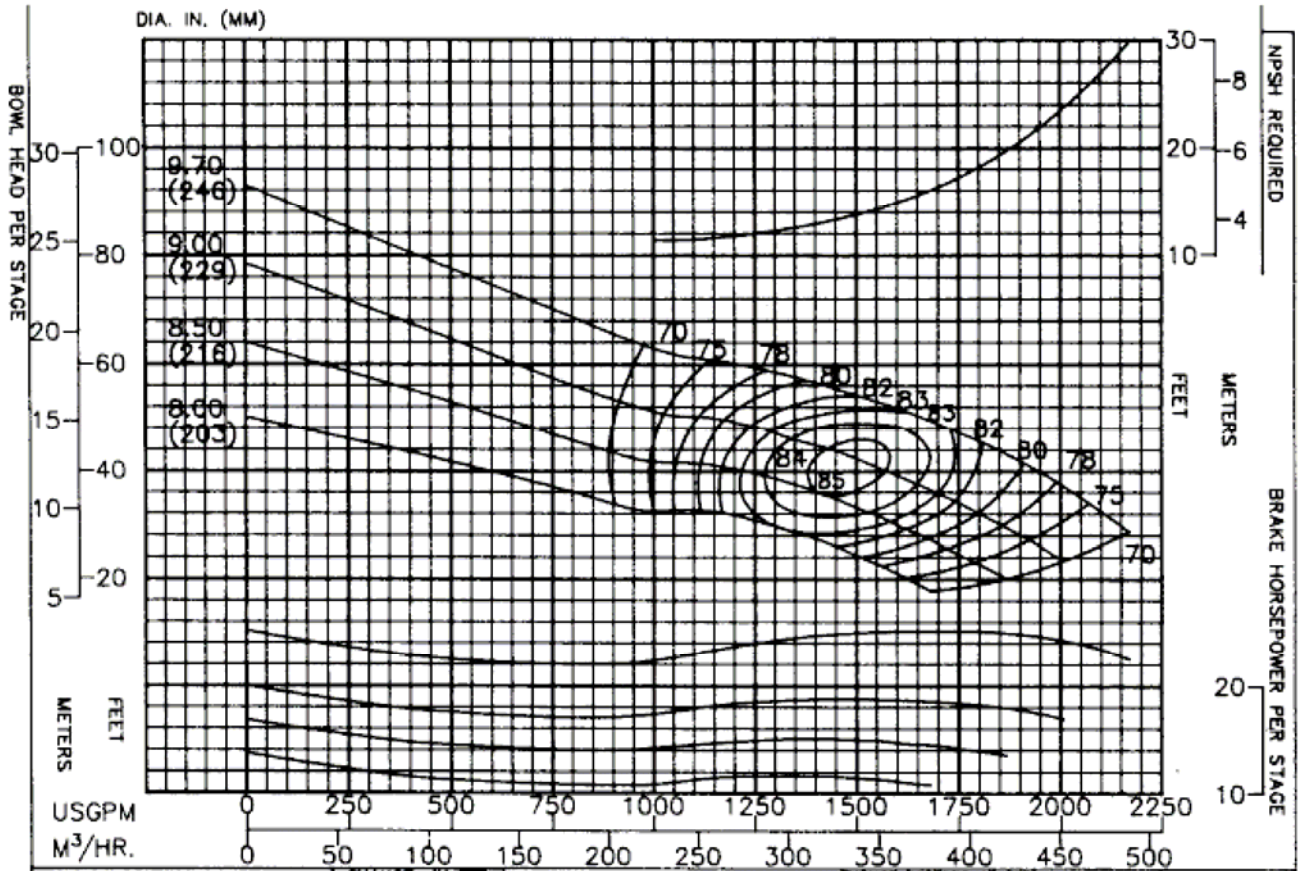

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MAT'LS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP		RPM	PUMP
BOWL – CAST IRON – LINED	1	-2		IMPELLER LBS/FT	KG/M	1770	12NKL
IMPELLER – BRONZE	2	-1		STANDARD 11.7	17.4	ENCLOSED IMPELLER	CURVE NO.
	3	0		BALANCED 9.0	13.3		EC–1389
				EYE AREA–27.8 SQ. IN.		N_s = 3940	