


Dated May 24, 1991

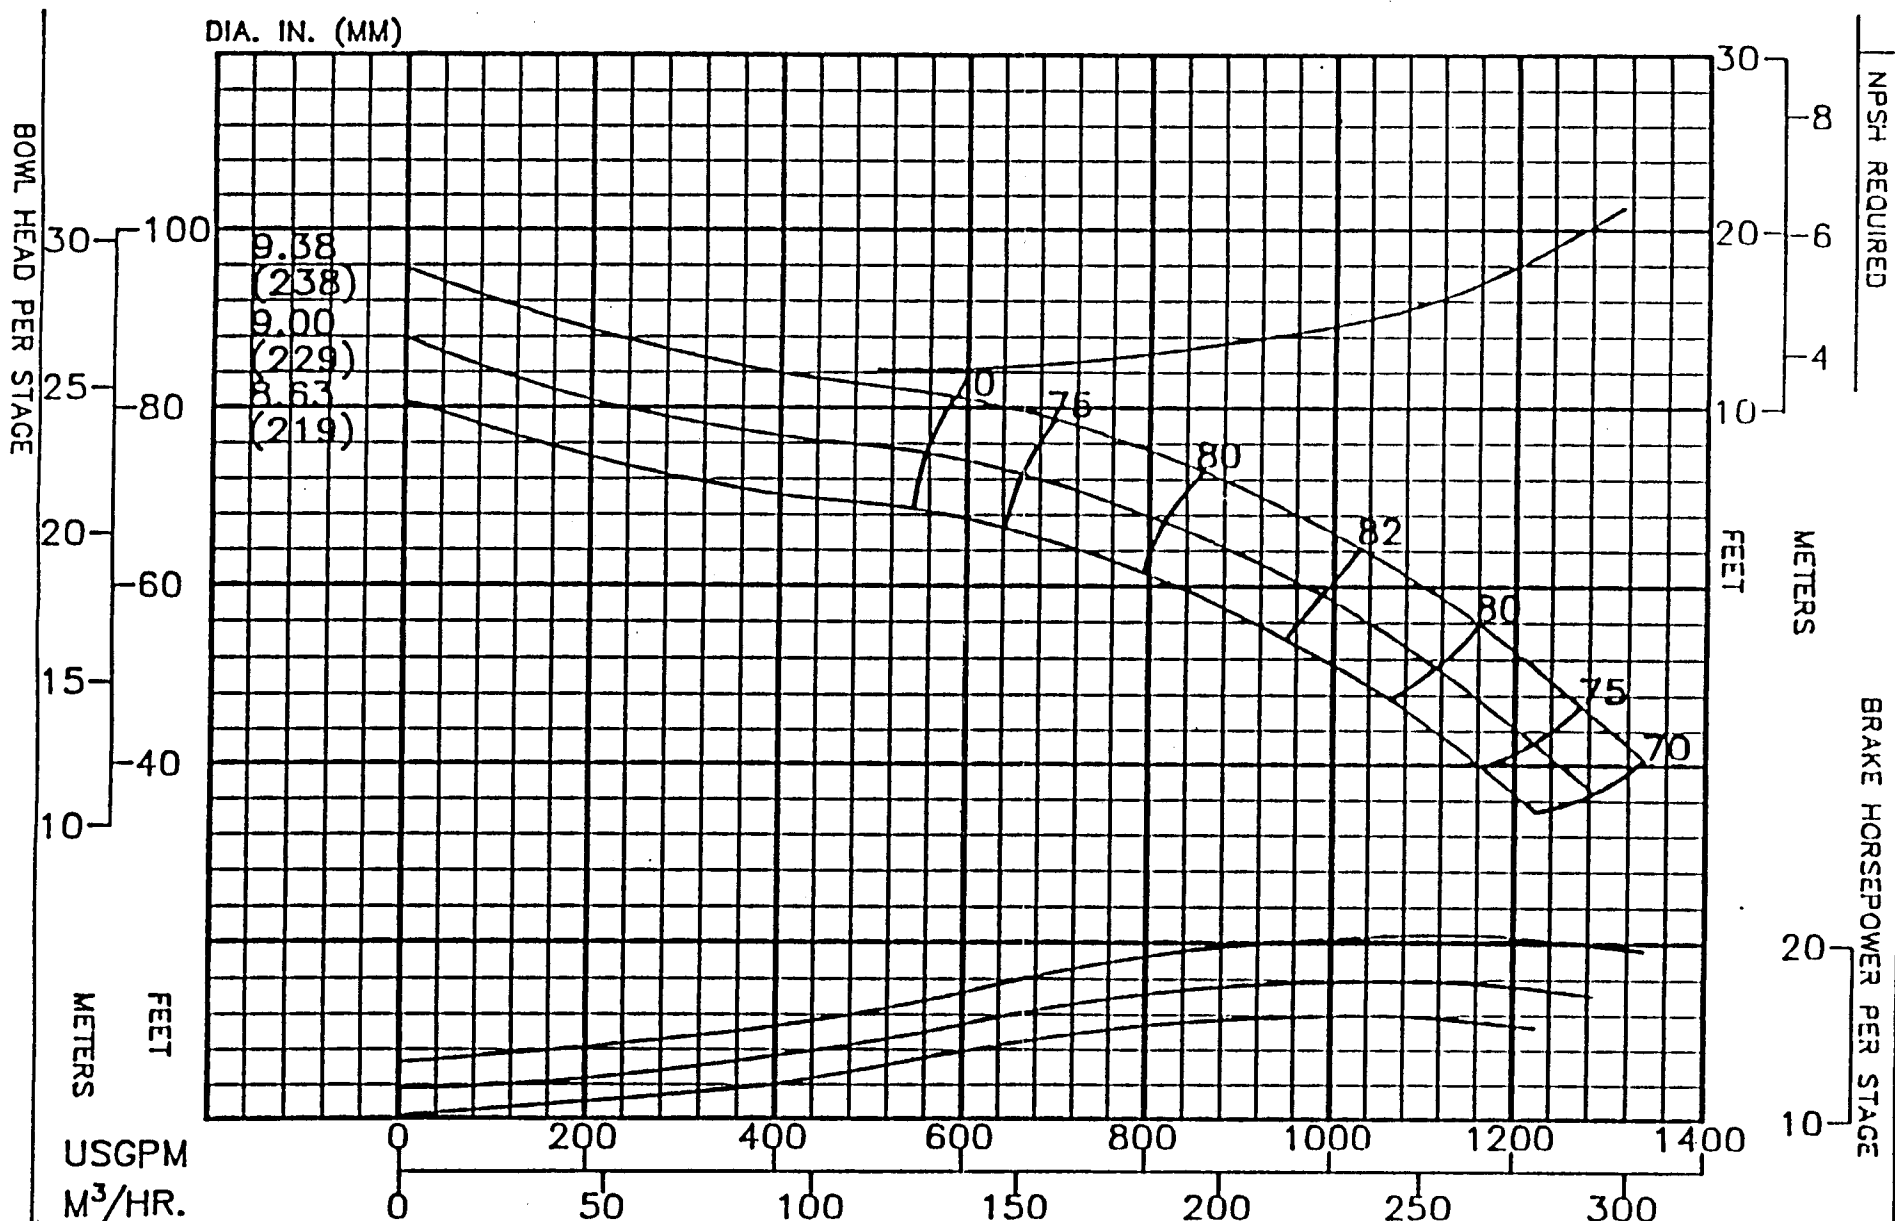

PERFORMANCE BASED ON PUMPING
CLEAR WATER BELOW 85°F. WITH LISTED
MATS. COLUMN LOSSES NOT INCLUDED.
BOWL - CAST IRON
IMPELLER - BRONZE

CHANGE IN EFF.	STAGES	POINTS
1	2	1
2	3	0

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	IBS/FT	KG/M
STANDARD	15.5	23.1
BALANCED	----	----
EYE AREA-24.2 SQ. IN.		

RPM	1775
SEMIOPEN IMPELLER	
N _s - 2510	

PUMP	14CM
CURVE NO.	EC-1895