APW - VERTICAL PUMPS

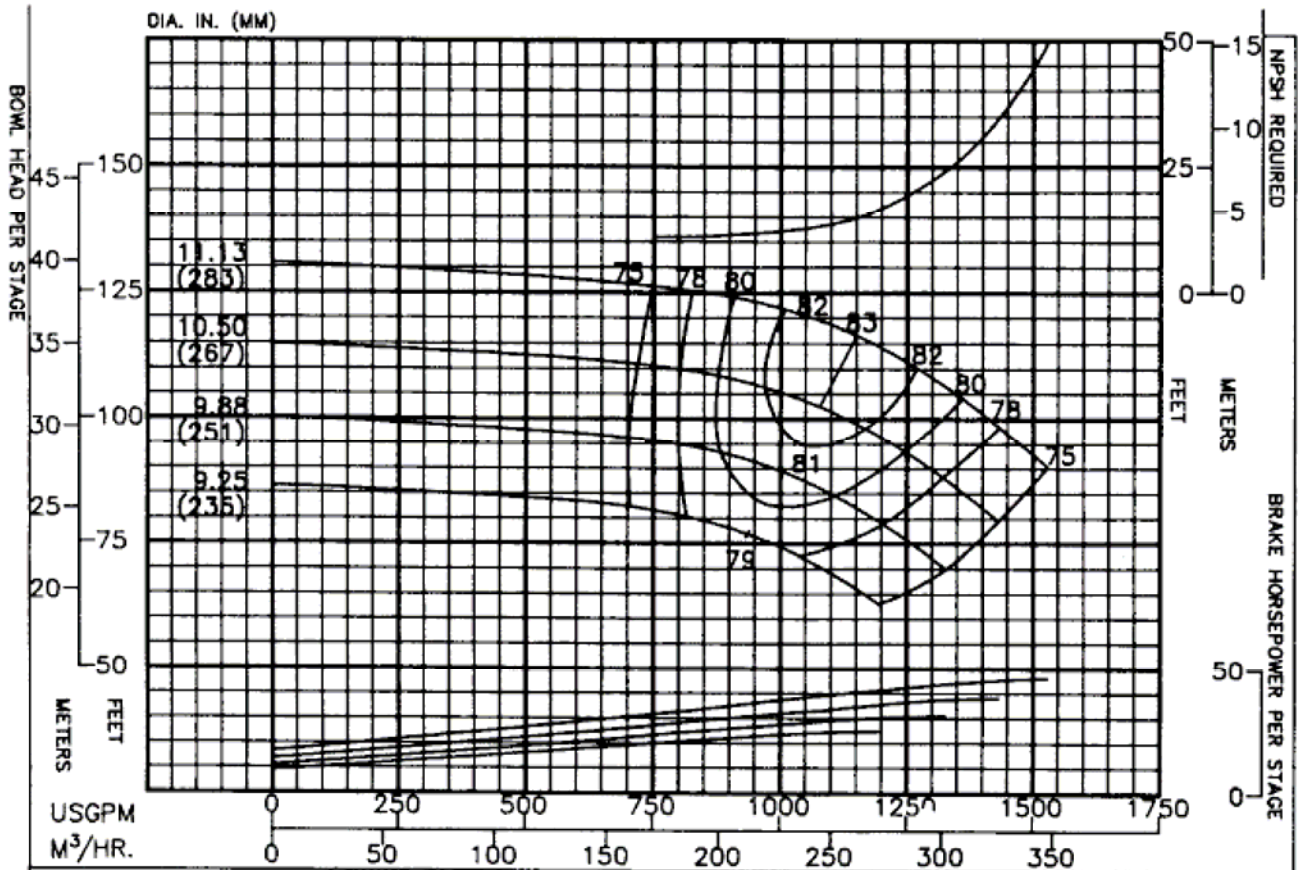

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS
BOWL – CAST IRON – LINED	1	-1½
IMPELLER – BRONZE	2	-1
	3	-½
	4	0

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	5.4	8.0
BALANCED	2.6	3.9
EYE AREA–18.6 SQ. IN.		

RPM 1775
ENCLOSED IMPELLER
N_s = 1700

PUMP 14JKH
CURVE NO. EC–1452