APW - VERTICAL PUMPS

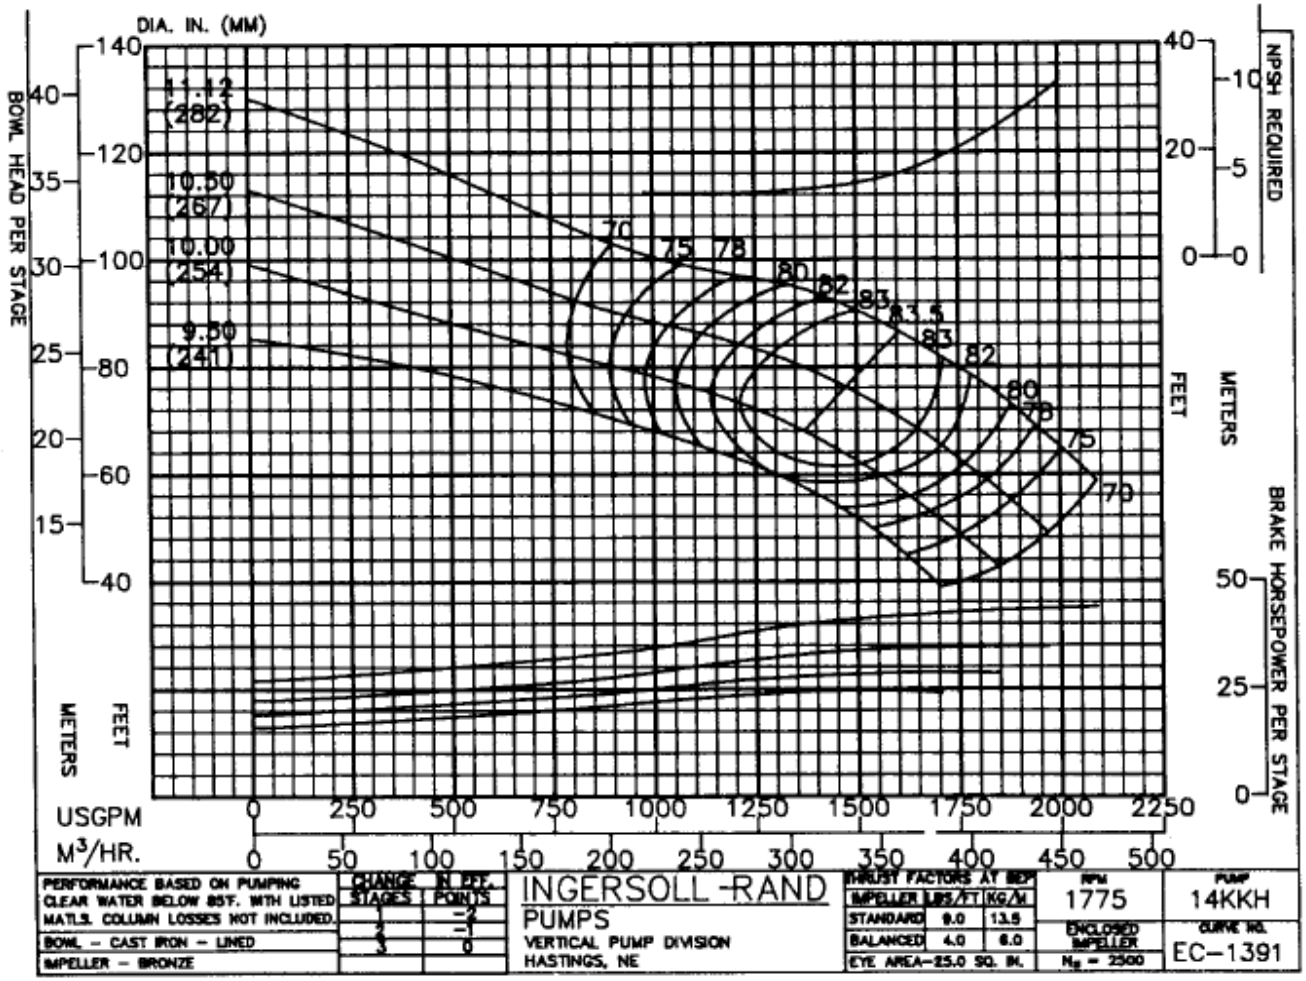

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP IMPELLER LBS/FT	KG/M	RPM 1775	PUMP 14KKH
BOWL – CAST IRON – LINED	1	-2		STANDARD 9.0	13.5	ENCLOSED IMPELLER	CURVE NO. EC-1391
IMPELLER – BRONZE	2	-4		BALANCED 4.0	6.0	N_{ss} = 2500	
	3	0		EYE AREA–25.0 SQ. IN.			