APW - VERTICAL PUMPS

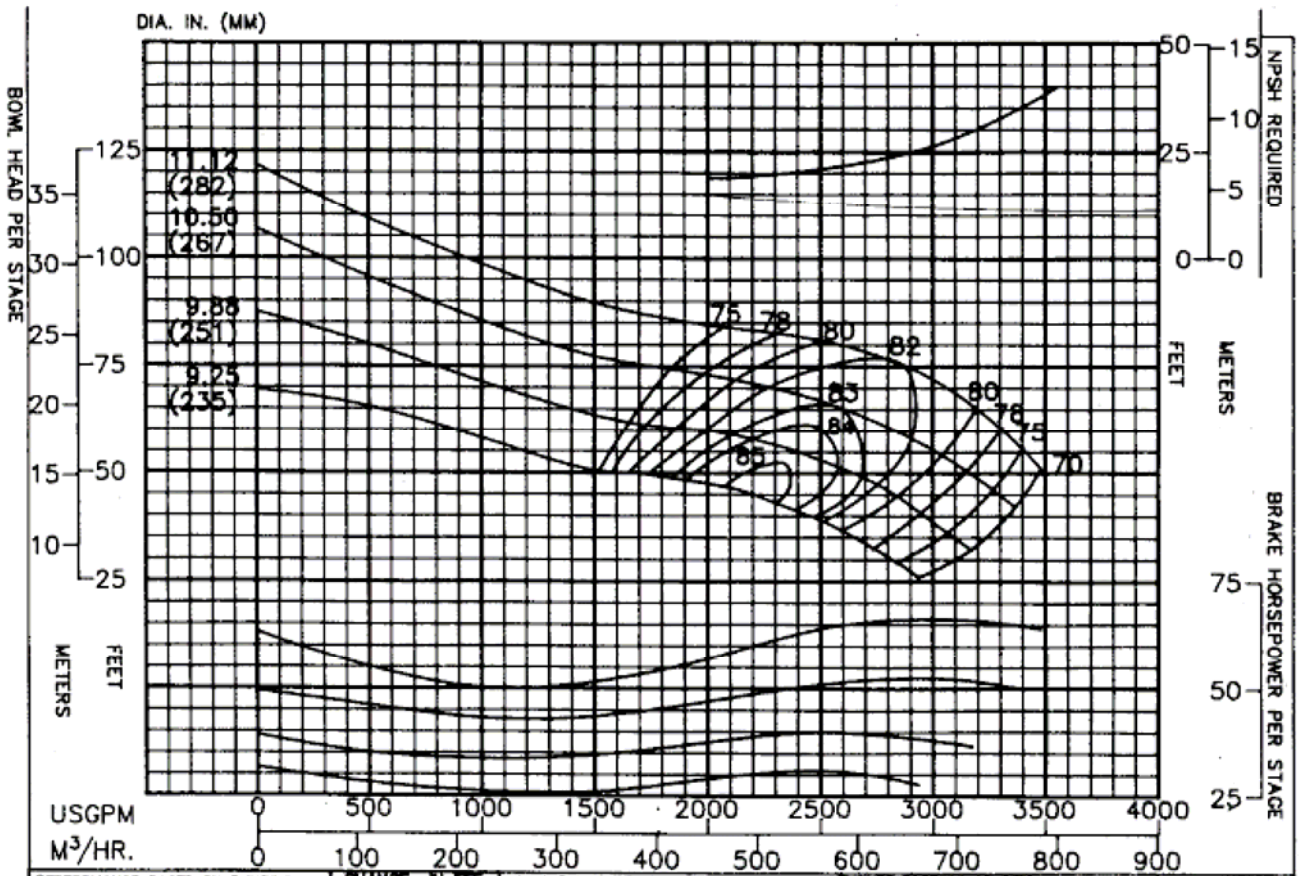

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE IN STAGES	IN EFF. POINTS
BOWL – CAST IRON – LINED	1	-1½
IMPELLER – BRONZE	2	-1
	3	0

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	13.4	20.0
BALANCED	8.8	14.6
EYE AREA–38.5 SQ. IN.		

RPM	PUMP
1775	14NKH
ENCLOSED IMPELLER	CURVE NO.
N_s = 3700	EC–1354