APW - VERTICAL PUMPS

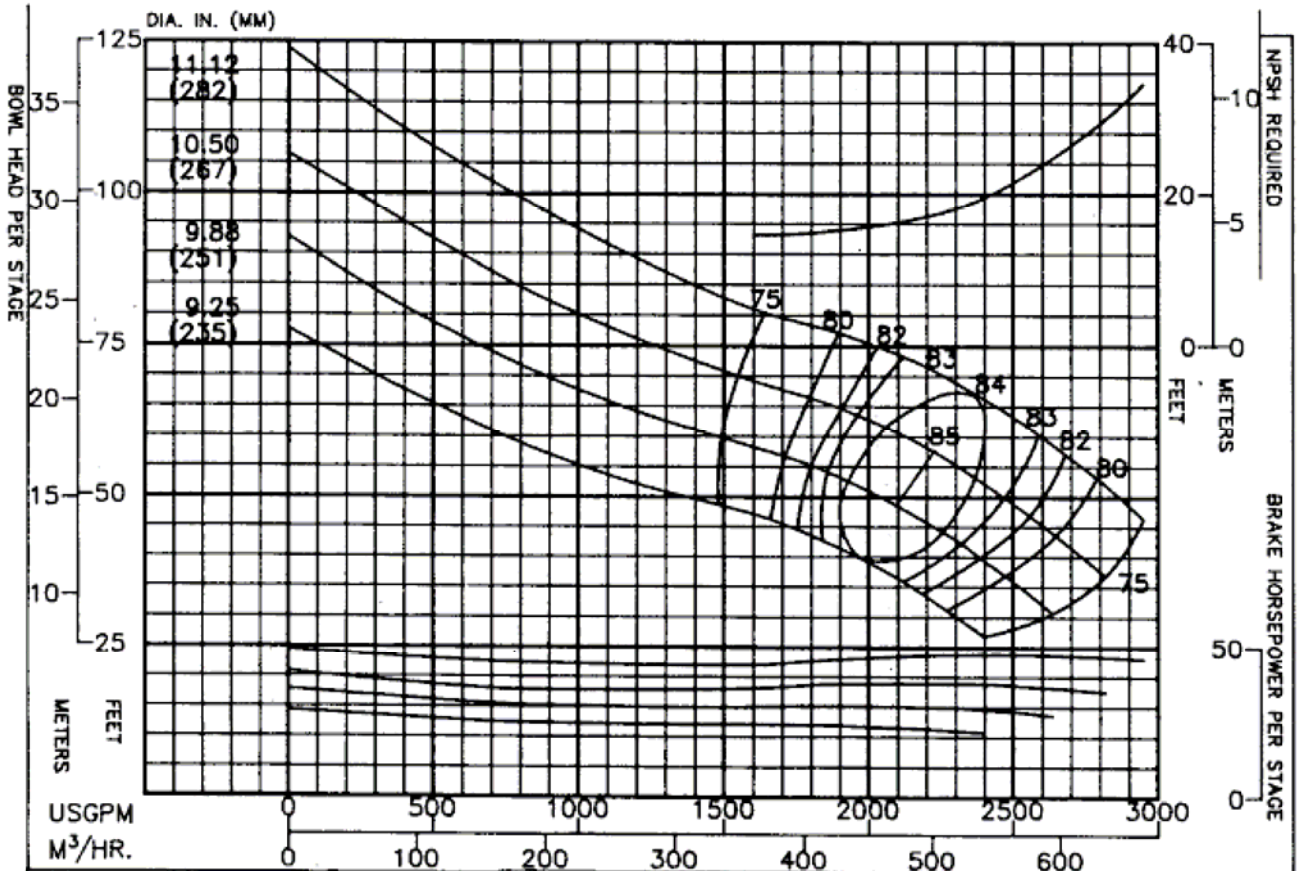

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN DEF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP: IMPELLER / LBS/FT / KG/M	RPM 1775	PUMP 14NKL
BOWL – CAST IRON – LINED	1	-1		STANDARD 14.1 21.0	ENCLOSED IMPELLER	CURVE NO.
IMPELLER – BRONZE	2	-2		BALANCED 9.8 14.6		EC-1393
	3	0		EYE AREA–38.5 SQ. IN	N_s = 3665	