APW - VERTICAL PUMPS

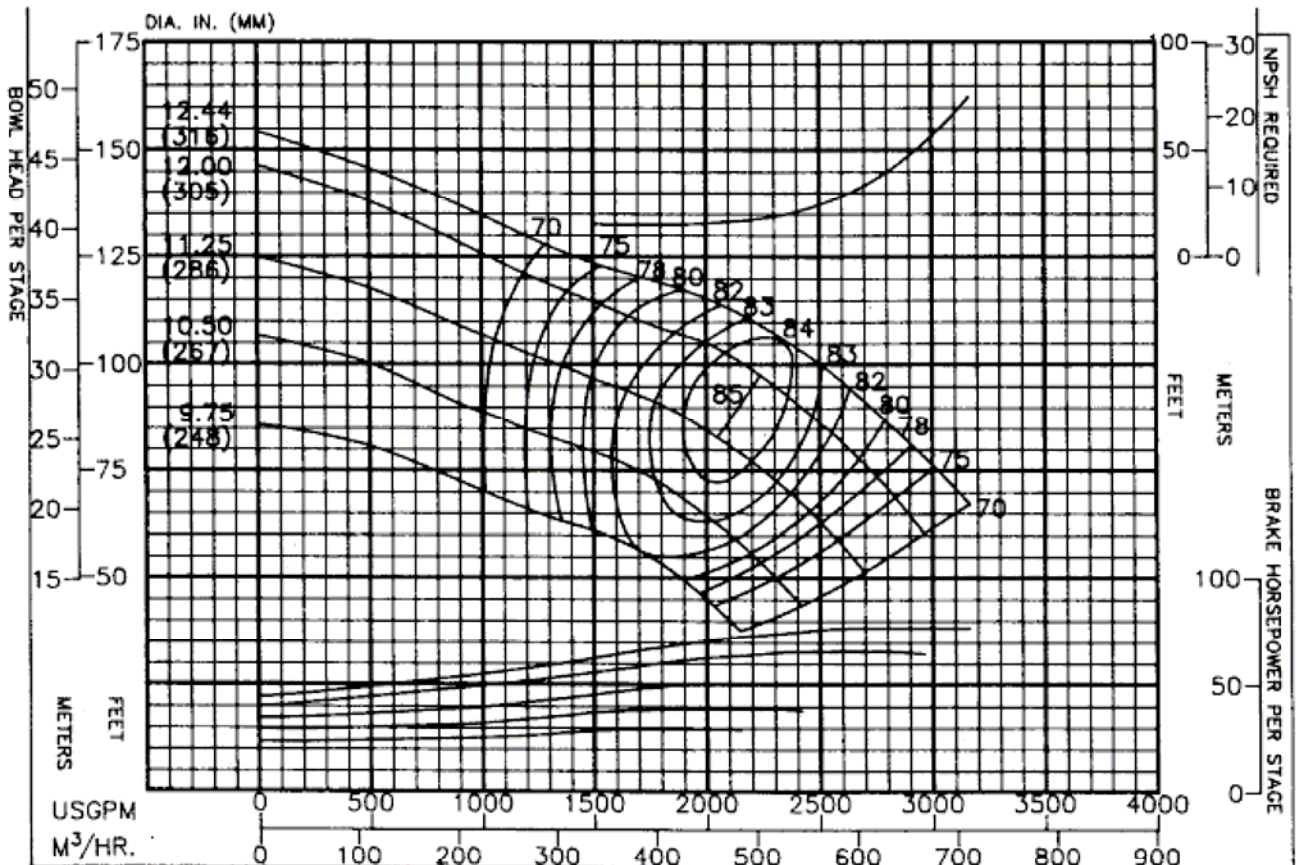

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE IN EFF. STAGES	POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP			RPM	PUMP
BOWL – CAST IRON – LINED	1	-1		IMPELLER	LBS/FT	KG/M	1775	16KKH
IMPELLER – BRONZE	2	0		STANDARD	11.4	17.0	ENCLOSED IMPELLER	CURVE NO.
				BALANCED	4.5	8.7		
				EYE AREA–31.3 SQ. IN.			N_s = 2610	EC–1399