APW - VERTICAL PUMPS

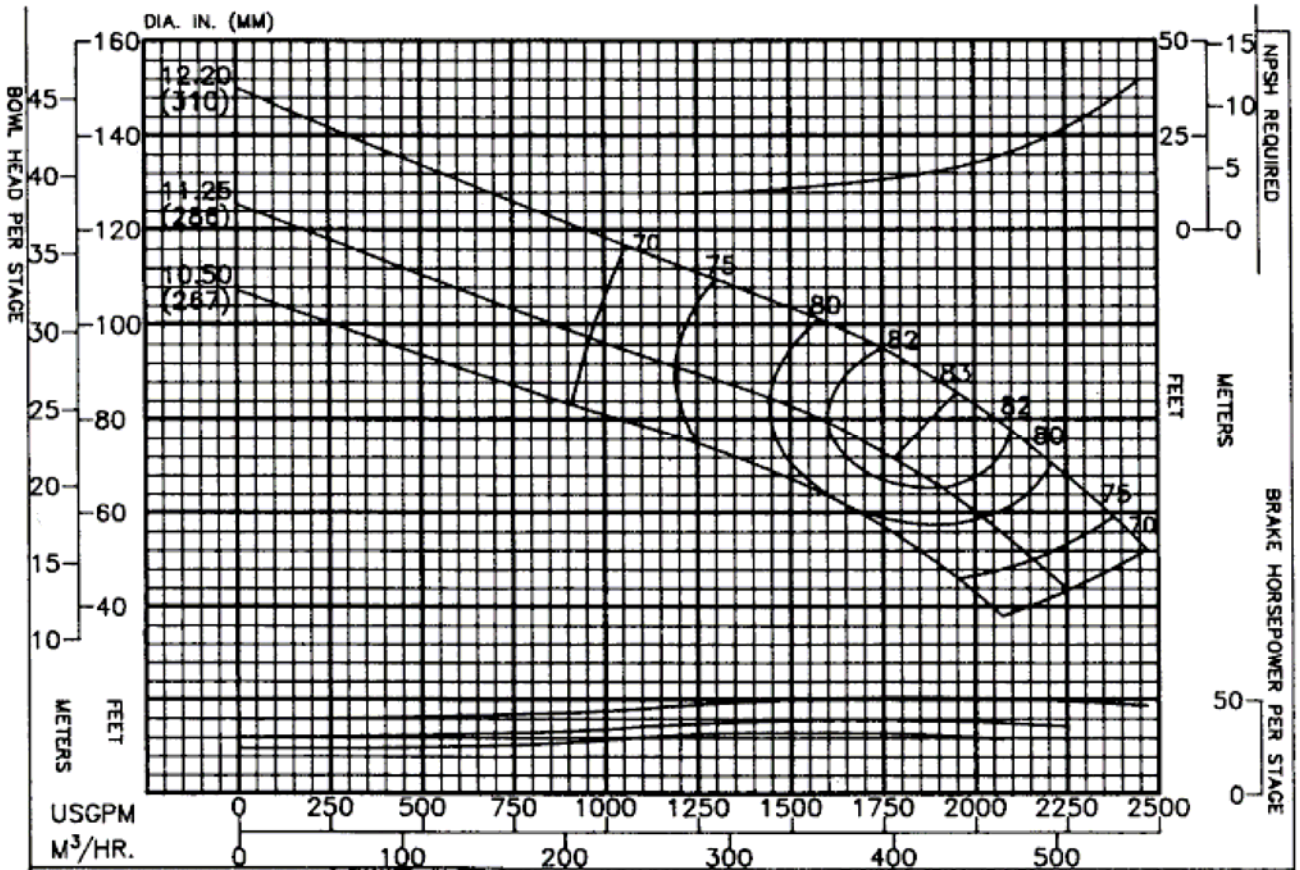

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN FT. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP: IMPELLER / LBS/FT / KG/M	RPM 1775	PUMP 16KKL
BOWL – CAST IRON – LINED	1	-2		STANDARD 12.7 18.9	ENCLOSED IMPELLER	CURVE NO.
IMPELLER – BRONZE	2	-1		BALANCED 4.5 6.7		EC–1444
	3	0		EYE AREA–31.3 SQ. IN.	N_s = 2780	