APW - VERTICAL PUMPS

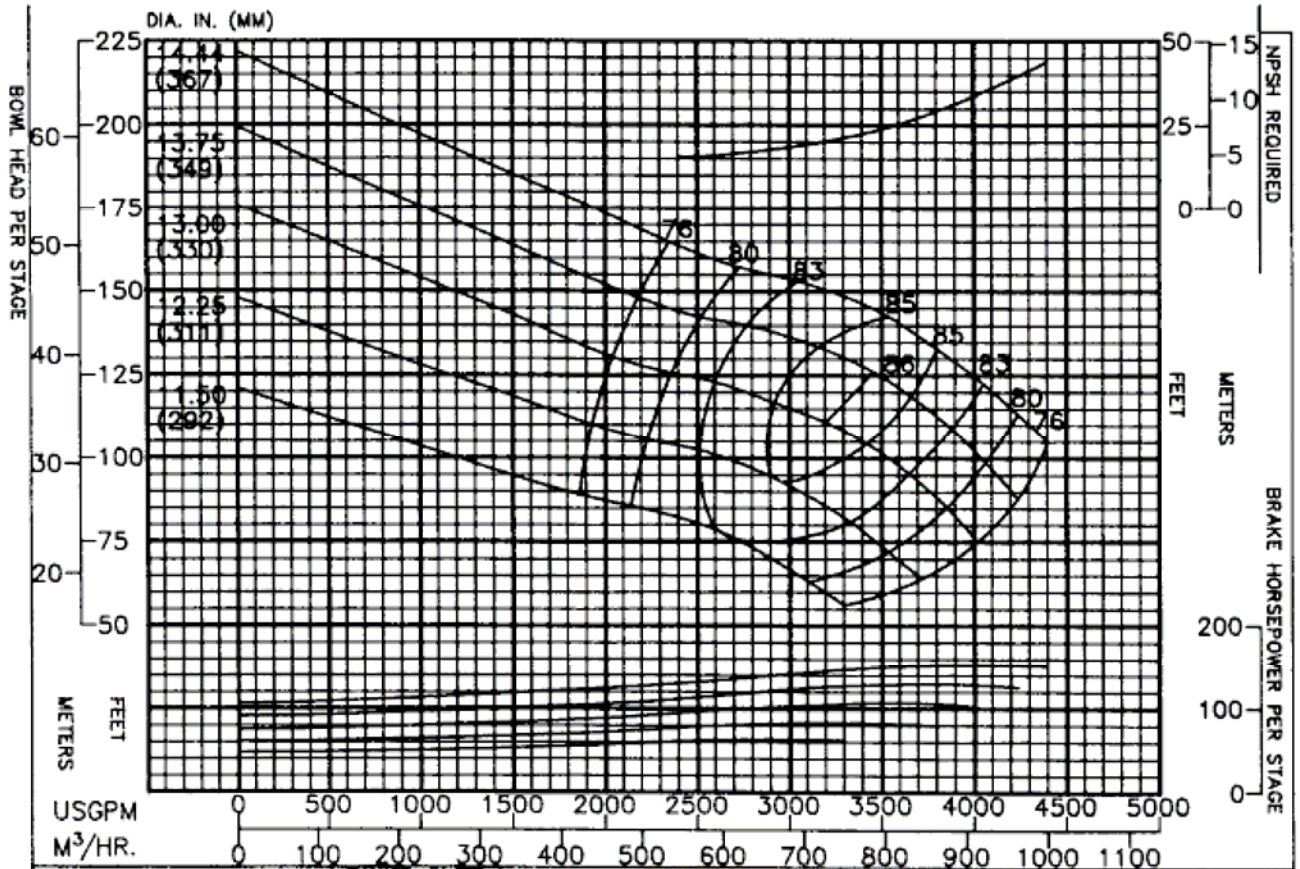

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN PCT. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP		RPM	PUMP
	1	-1		IMPELLER	LBS/FT	KG/M	1780	18KKH
BOWL – CAST IRON – LINED	2	-1		STANDARD	14.8	21.8	ENCLOSED IMPELLER	CURVE NO.
IMPELLER – BRONZE	3	0		BALANCED	5.8	8.7		EC-1448
				EYE AREA-47.3 SQ. IN.			N_s = 2680	