# APW - VERTICAL PUMPS



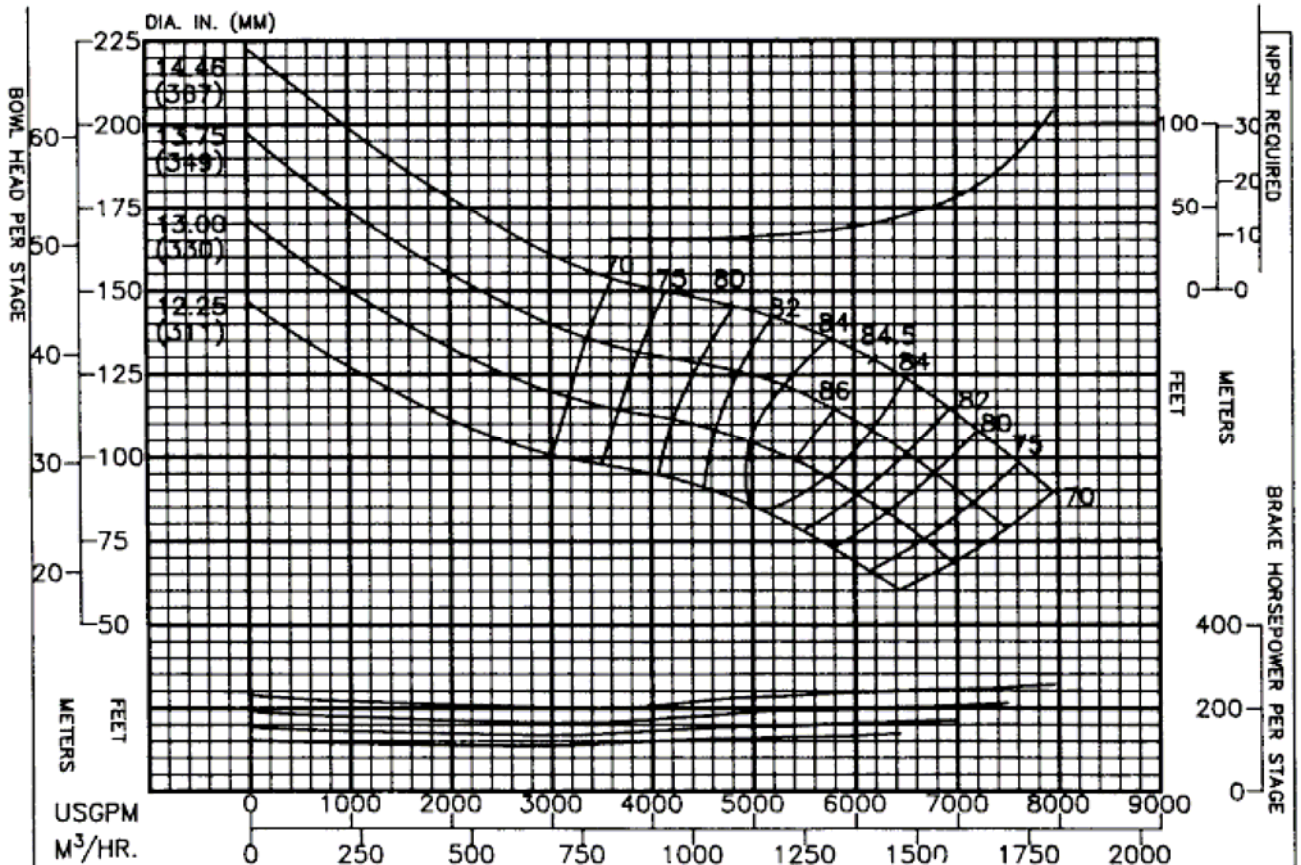


| | | | | | | | | |
|---|---|---|---|---|---|---|---|---|
| PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED. | CHANGE STAGES | IN EFF. POINTS | INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE | THRUST FACTORS AT BEP | | | RPM 1780 | PUMP 18NKH |
| BOWL – CAST IRON – LINED | 1 | -1 | | IMPELLER LBS/FT | KG/M | | | |
| IMPELLER – BRONZE | 2 | 0 | | STANDARD 22.1 | 32.9 | | ENCLOSED IMPELLER | CURVE NO. |
| | | | | BALANCED 15.7 | 23.4 | | | EC-1457 |
| | | | | EYE AREA-62.4 SQ. IN. | | | $N_s$ = 3640 | |