APW - VERTICAL PUMPS

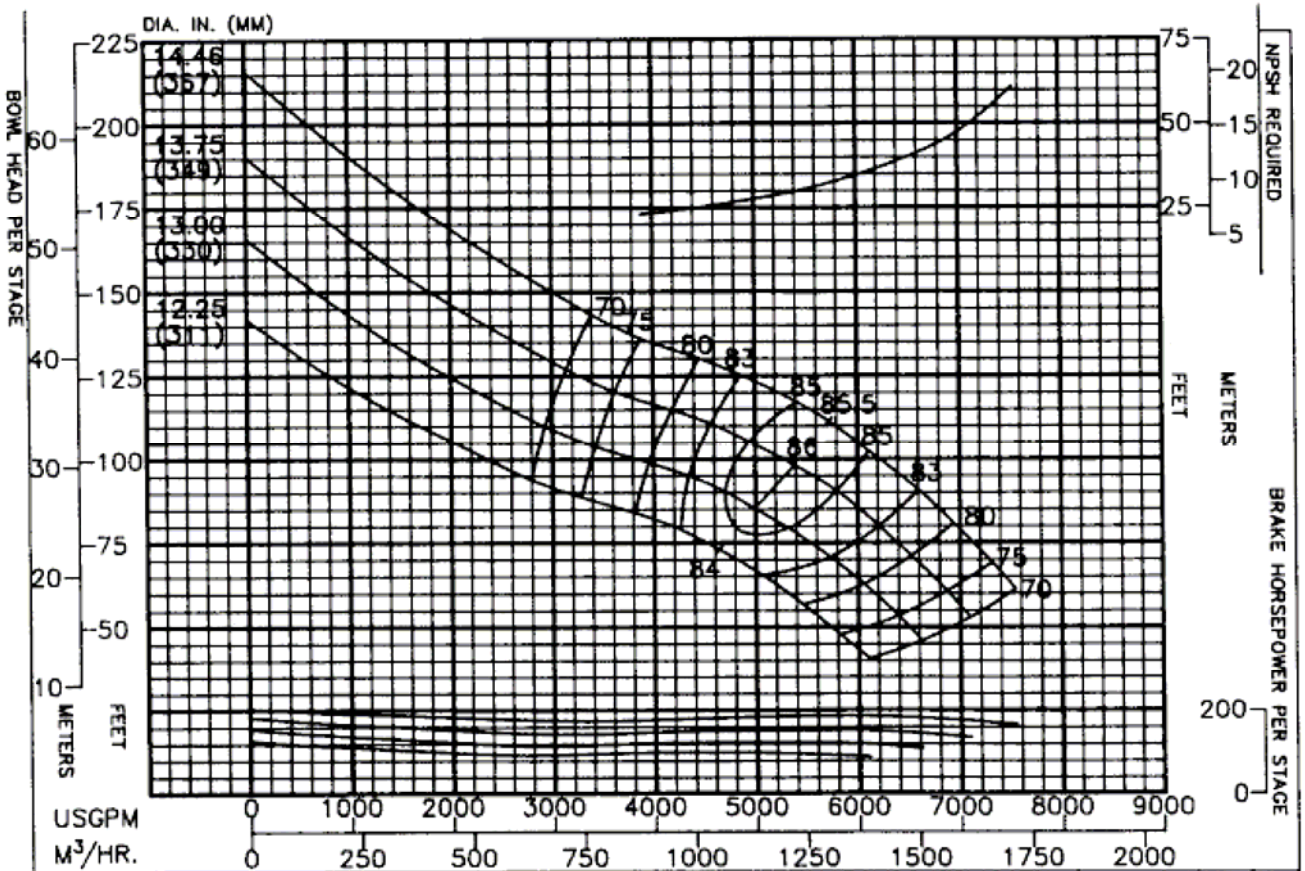

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP		RPM 1780	PUMP 18NKL
BOWL – CAST IRON – LINED	1	-1		IMPELLER	LBS/FT	KG/M	ENCLOSED IMPELLER
IMPELLER – BRONZE	2	0		STANDARD	23.2	34.6	CURVE NO.
				BALANCED	15.7	23.4	EC-1455
				EYE AREA-62.4 SQ. IN.		N_s = 3930	