APW - VERTICAL PUMPS

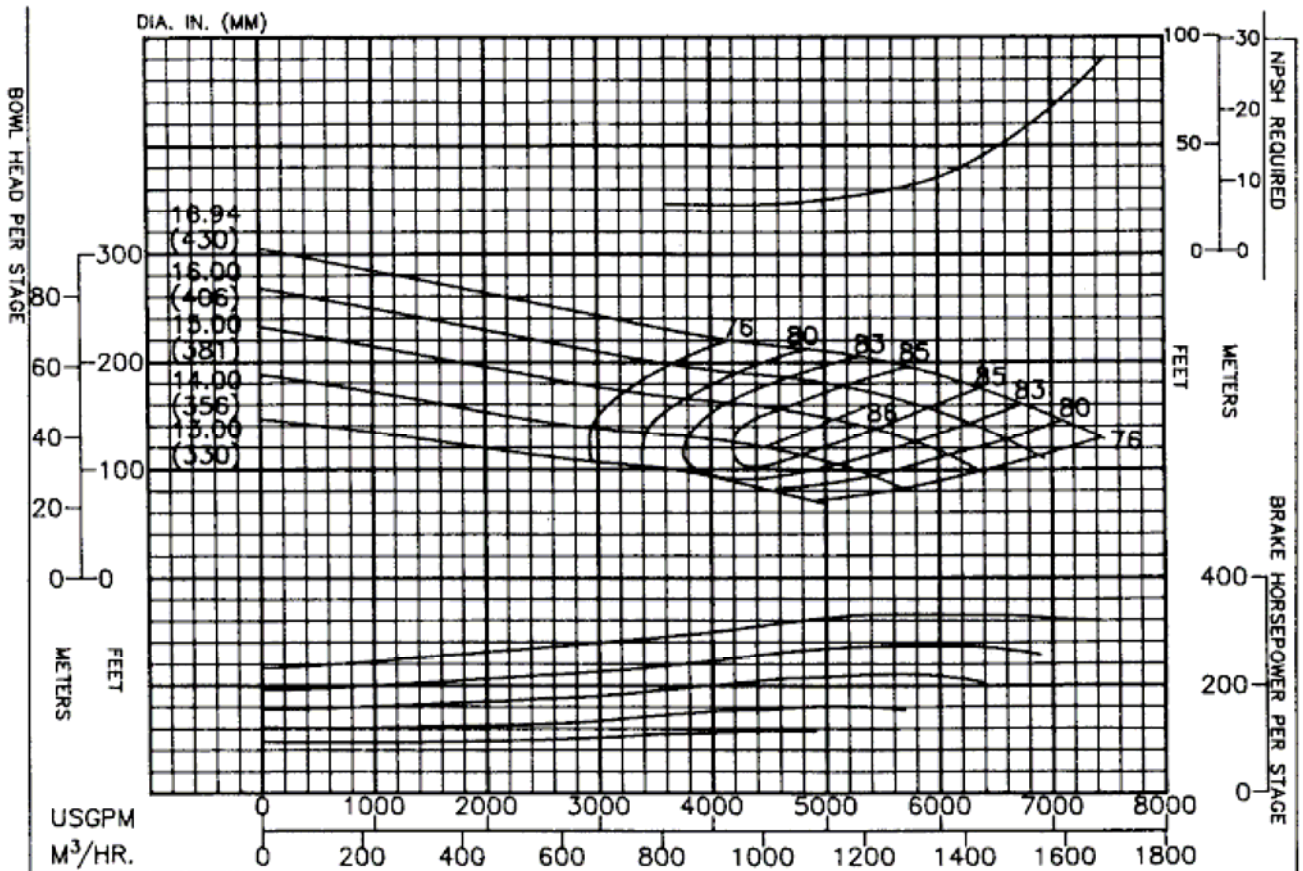

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP		RPM	PUMP
	1	2		IMPELLER	LBS/FT	KG/M	1780	20KKH
BOWL – CAST IRON – LINED	2	1		STANDARD	19.7	29.3	ENCLOSED IMPELLER	CURVE NO.
IMPELLER – BRONZE	3	0		BALANCED	10.0	14.9		EC-1363
				EYE AREA–60.5 SQ. IN.			N_s = 2740	