APW - VERTICAL PUMPS

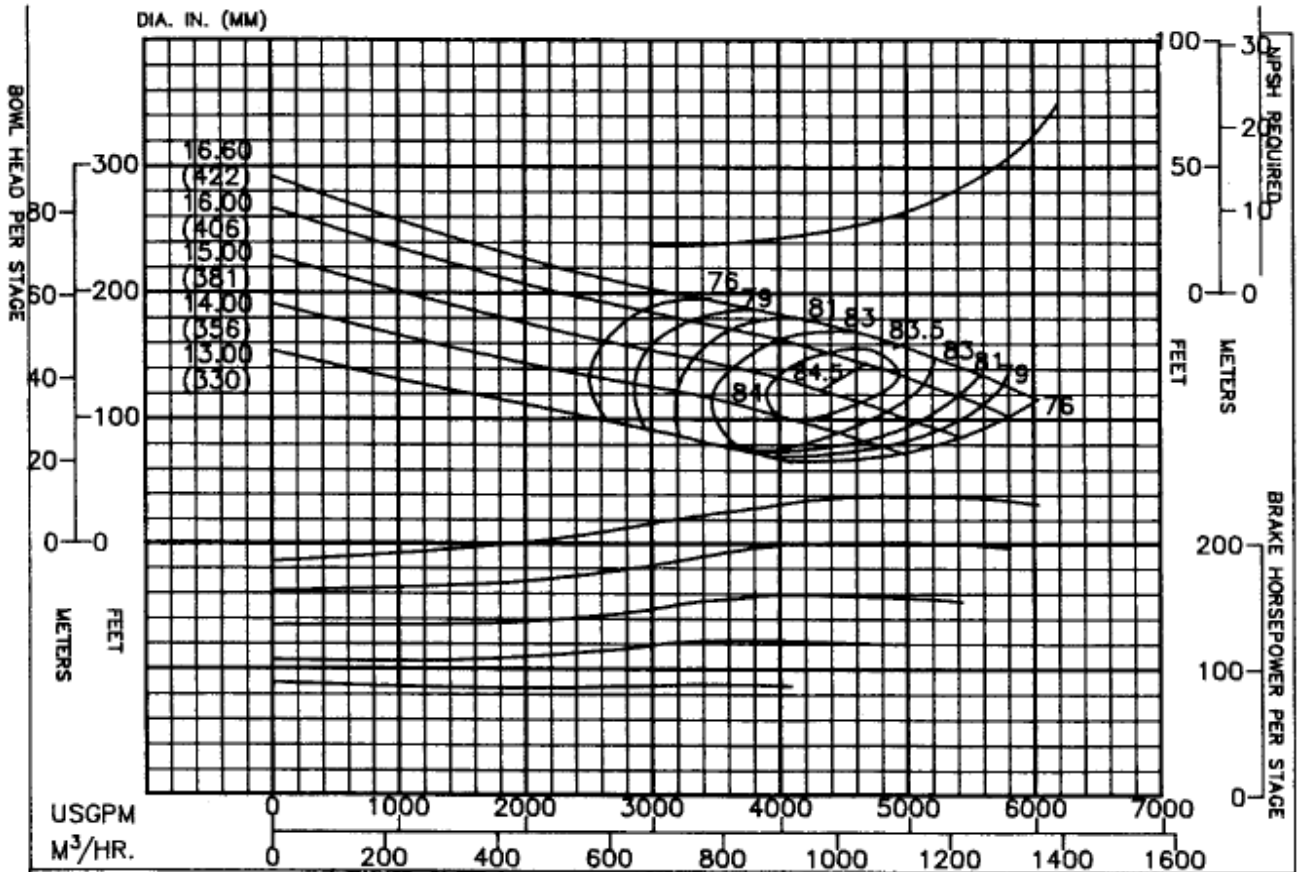

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE IN EFF. STAGES	POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP: IMPELLER LBS/FT	KG/M	RPM 1780	PUMP 20KKL
BOWL – CAST IRON – LINED	1	-2		STANDARD 21.1	31.4	ENCLOSED IMPELLER	CURVE NO.
IMPELLER – BRONZE	2	-1		BALANCED 8.8	14.8		EC–1357
	3	0		EYE AREA–60.5 SQ. IN.		N_s = 2800	