APW - VERTICAL PUMPS

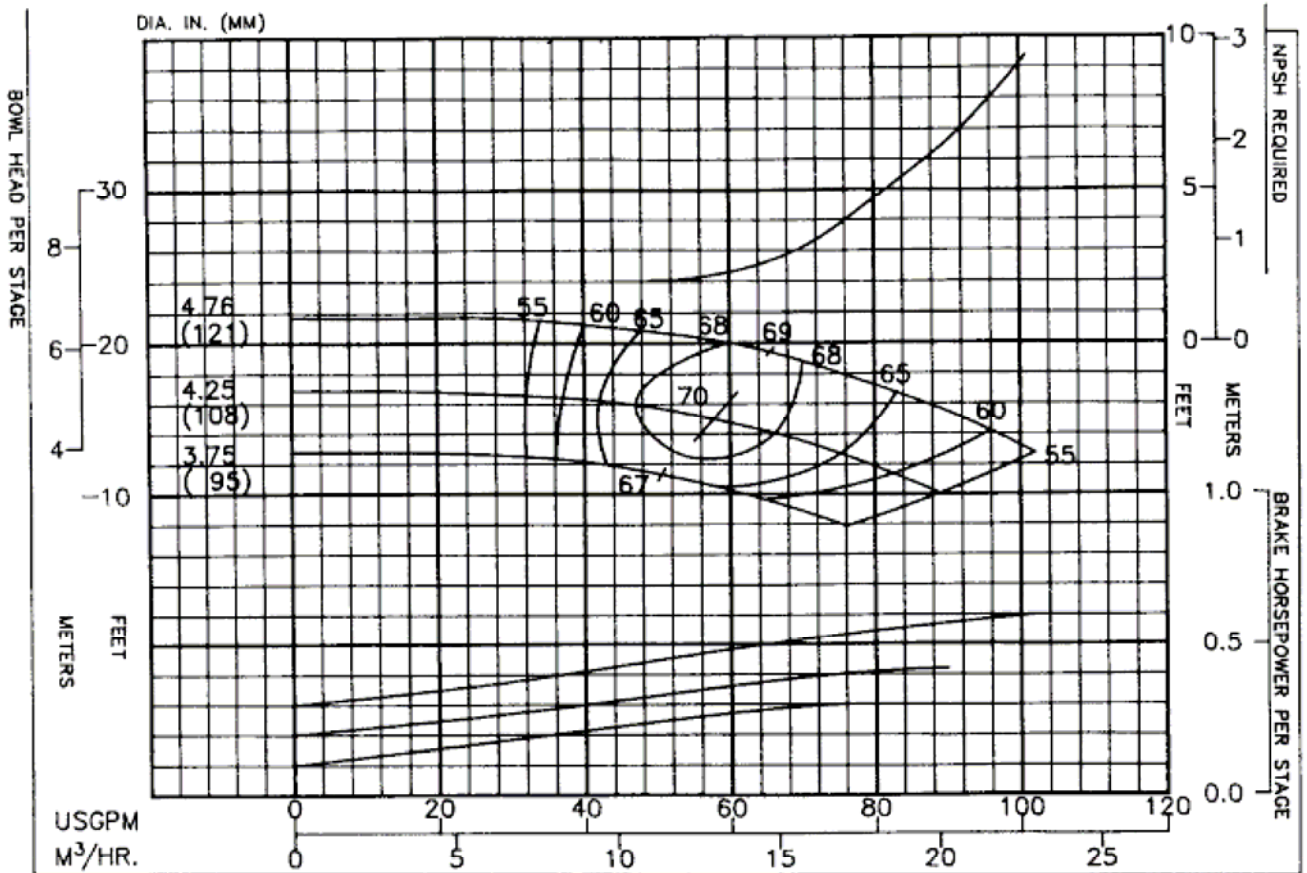

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP		RPM 1760	PUMP 6JKH
BOWL – CAST IRON – LINED	1	5		IMPELLER	LBS/FT	KG/M	
IMPELLER – BRONZE	2	3		STANDARD	1.00	1.48	ENCLOSED IMPELLER
	3	2		BALANCED	.30	.45	CURVE NO. EC–1375
	4	1		EYE AREA–2.91 SQ. IN.		N_s = 1535	