APW - VERTICAL PUMPS

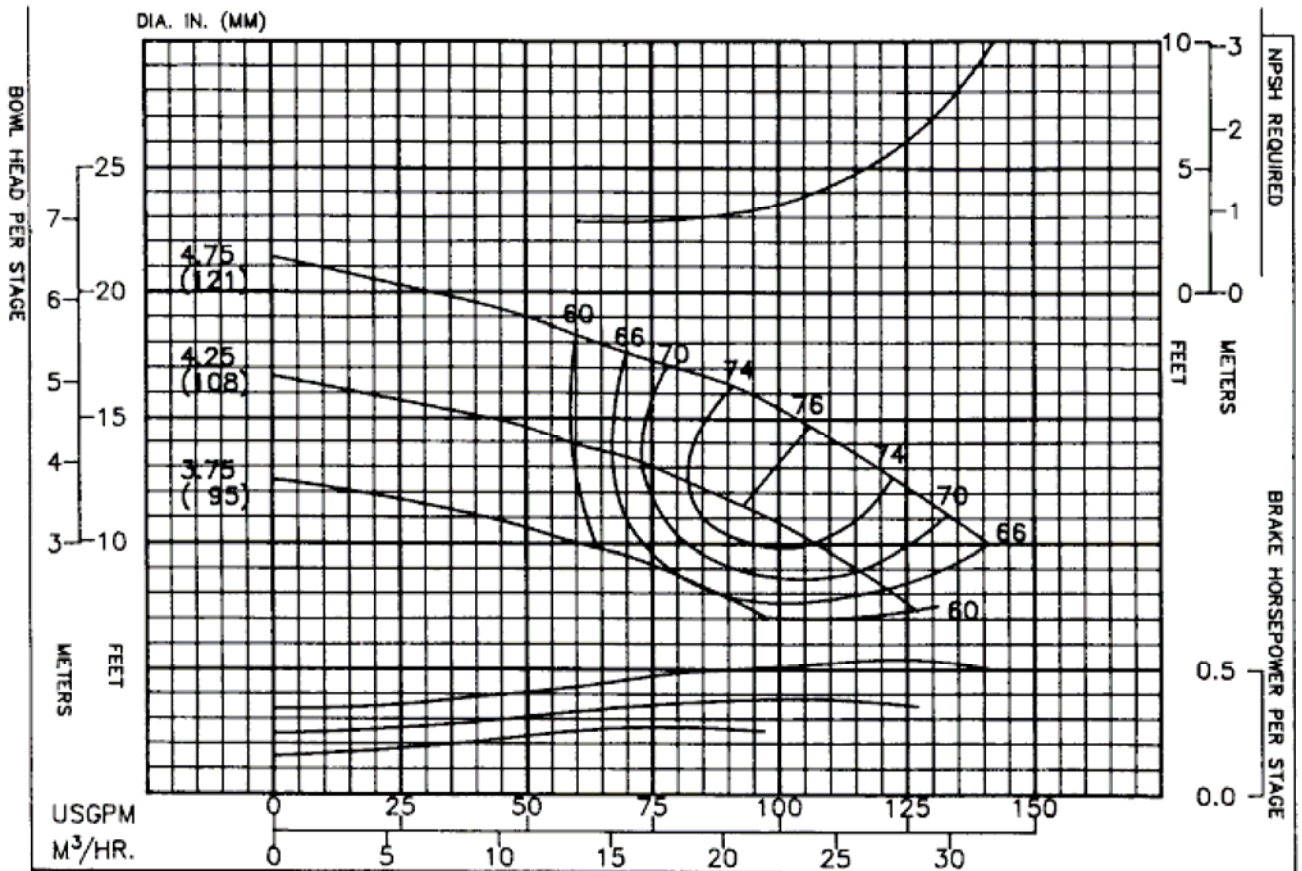

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP		RPM 1760	PUMP 6KKH
BOWL – CAST IRON – LINED	1	5		IMPELLER LBS/FT	KG/M		
IMPELLER – BRONZE	2	4		STANDARD 1.50	2.24	ENCLOSED IMPELLER	CURVE NO.
	3	3		BALANCED 1.10	1.64		EC–1378
	4	2		EYE AREA–4.3 SQ. IN.		N_s = 2410	
	5	1					