APW - VERTICAL PUMPS

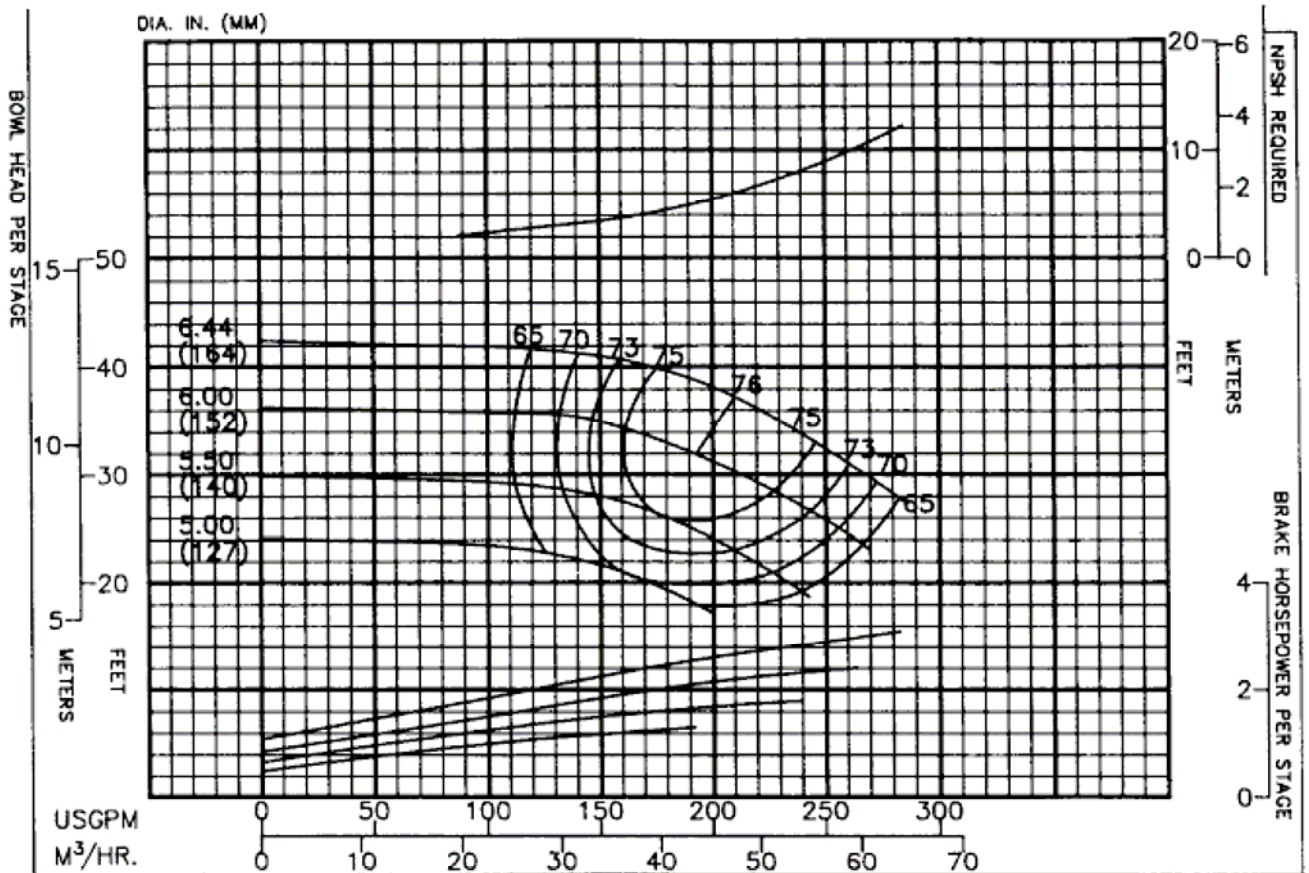

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS
BOWL – CAST IRON – LINED	1	4
IMPELLER – BRONZE	2	3
	3	2
	4	1

INGERSOLL-RAND
PUMPS
VERTICAL PUMP DIVISION
HASTINGS, NE

THRUST FACTORS AT BEP		
IMPELLER	LBS/FT	KG/M
STANDARD	2.10	3.13
BALANCED	1.37	2.04
EYE AREA–5.7 SQ. IN.		

RPM	PUMP
1770	8JKH
ENCLOSED IMPELLER	CURVE NO.
N_s = 1690	EC–1361