APW - VERTICAL PUMPS

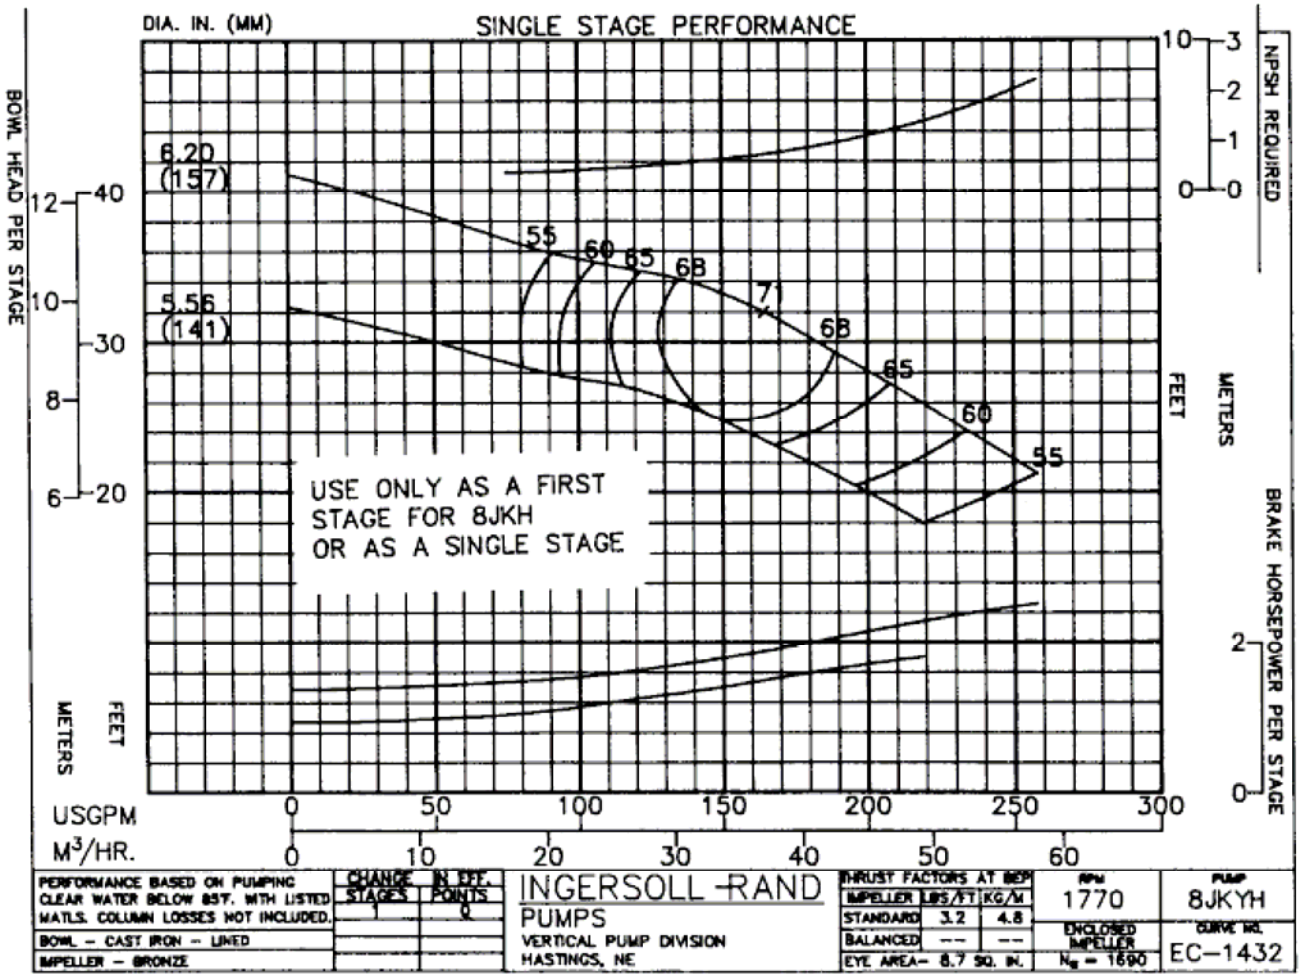

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW BST. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES 1	IN EFF. POINTS 0	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP: IMPELLER LBS/FT KG/M; STANDARD 3.2 4.8; BALANCED -- --	RPM 1770	PUMP 8JKYH
BOWL – CAST IRON – LINED				EYE AREA – 8.7 SQ. IN.	ENCLOSED IMPELLER N_s = 1690	CURVE NO. EC–1432
IMPELLER – BRONZE						