APW - VERTICAL PUMPS

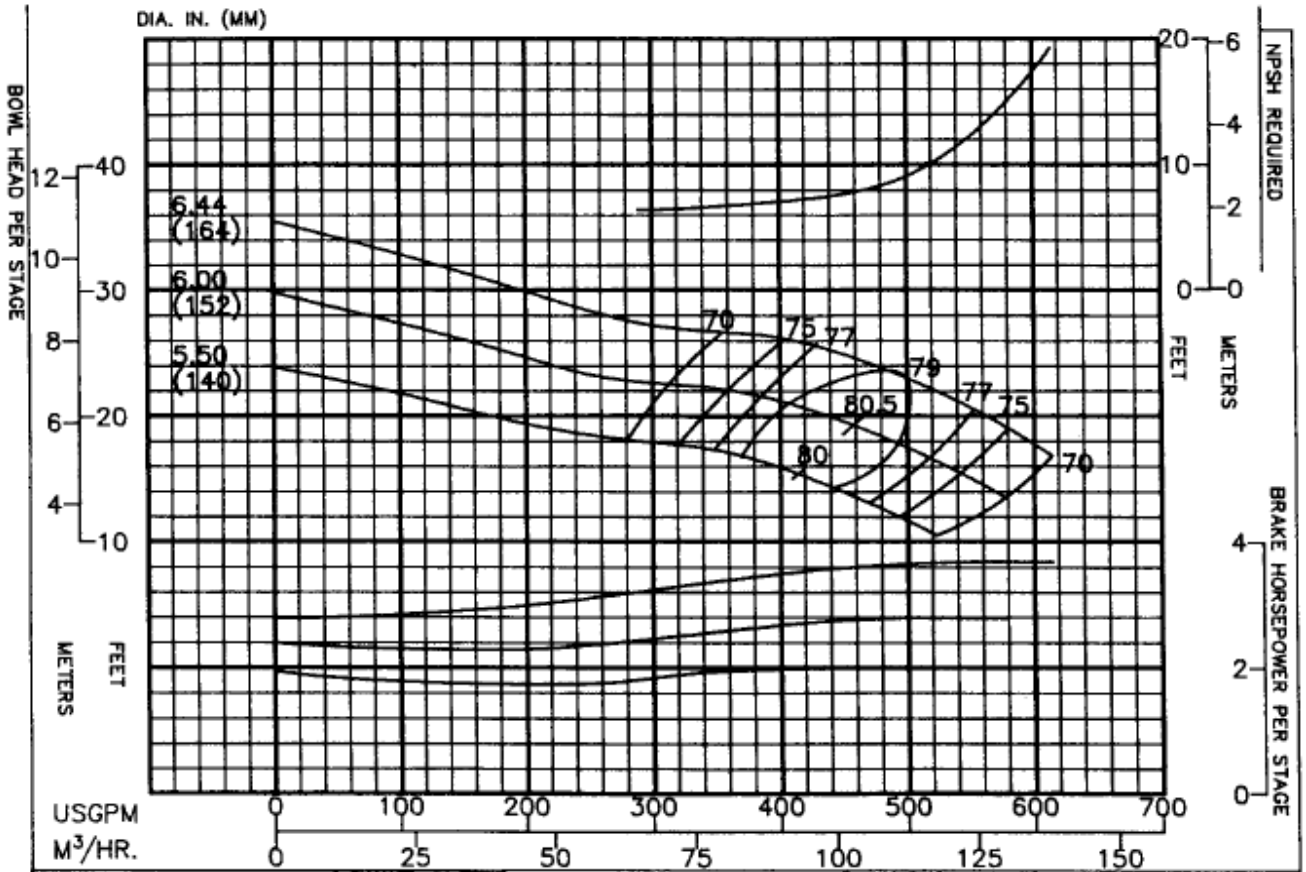

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP		RPM 1770	PUMP 8NKH
BOWL – CAST IRON – LINED	1	-3		IMPELLER	LBS/FT	KG/M	
IMPELLER – BRONZE	2	-2		STANDARD	5.0	7.5	
	3	-1		BALANCED	3.1	4.6	ENCLOSED IMPELLER
	4	0		EYE AREA–11.3 SQ. IN.		N_s = 3750	CURVE NO. EC–1371