APW - VERTICAL PUMPS

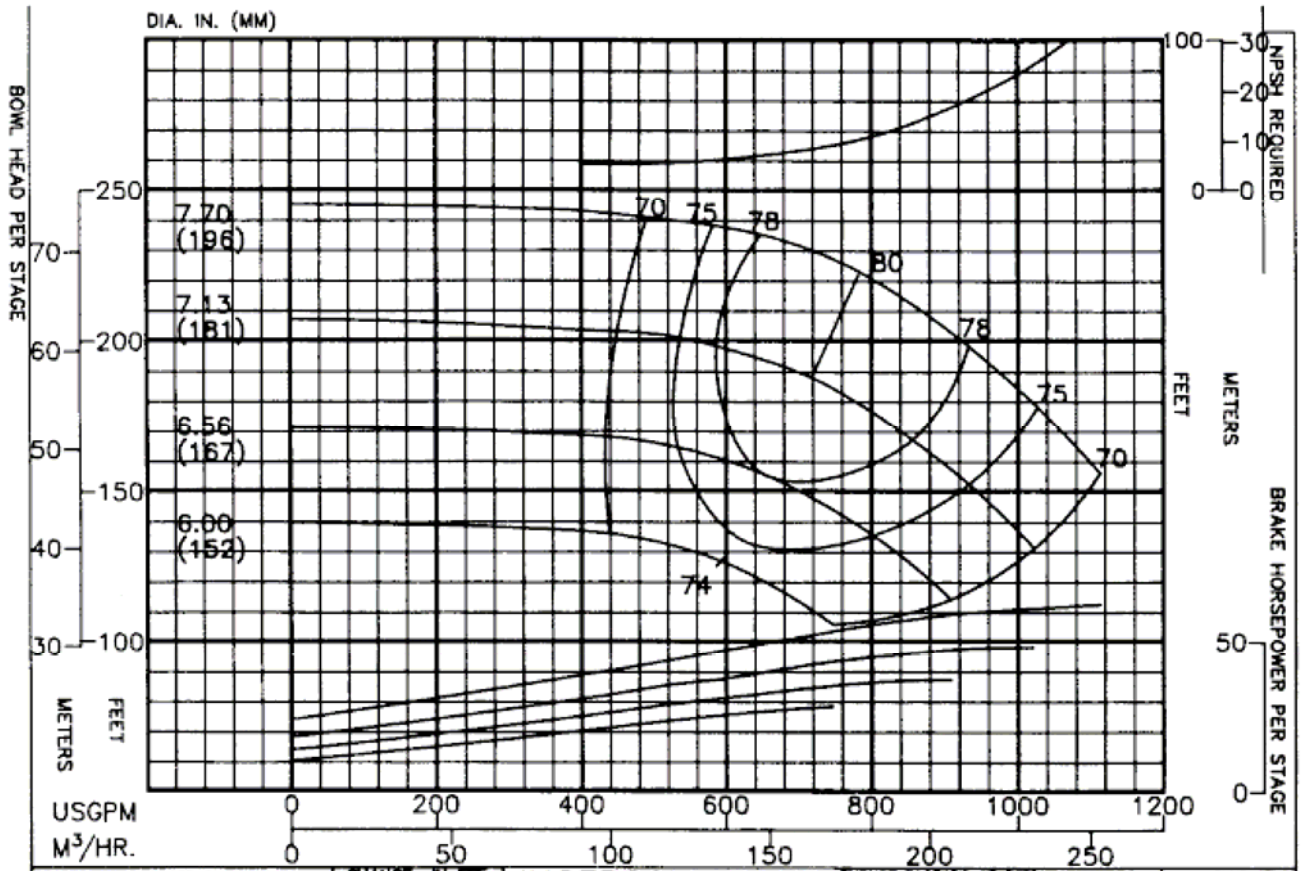

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP		RPM	PUMP
BOWL – CAST IRON – LINED	1	-3		IMPELLER	LBS/FT	KG/M	3550	10JKH
IMPELLER – BRONZE	2	-2		STANDARD	3.1	4.6		
	3	-1		BALANCED	2.5	3.7	ENCLOSED IMPELLER	CURVE NO.
	4	0		EYE AREA–8.64 SQ. IN.			N_s = 1720	EC–1477