APW - VERTICAL PUMPS

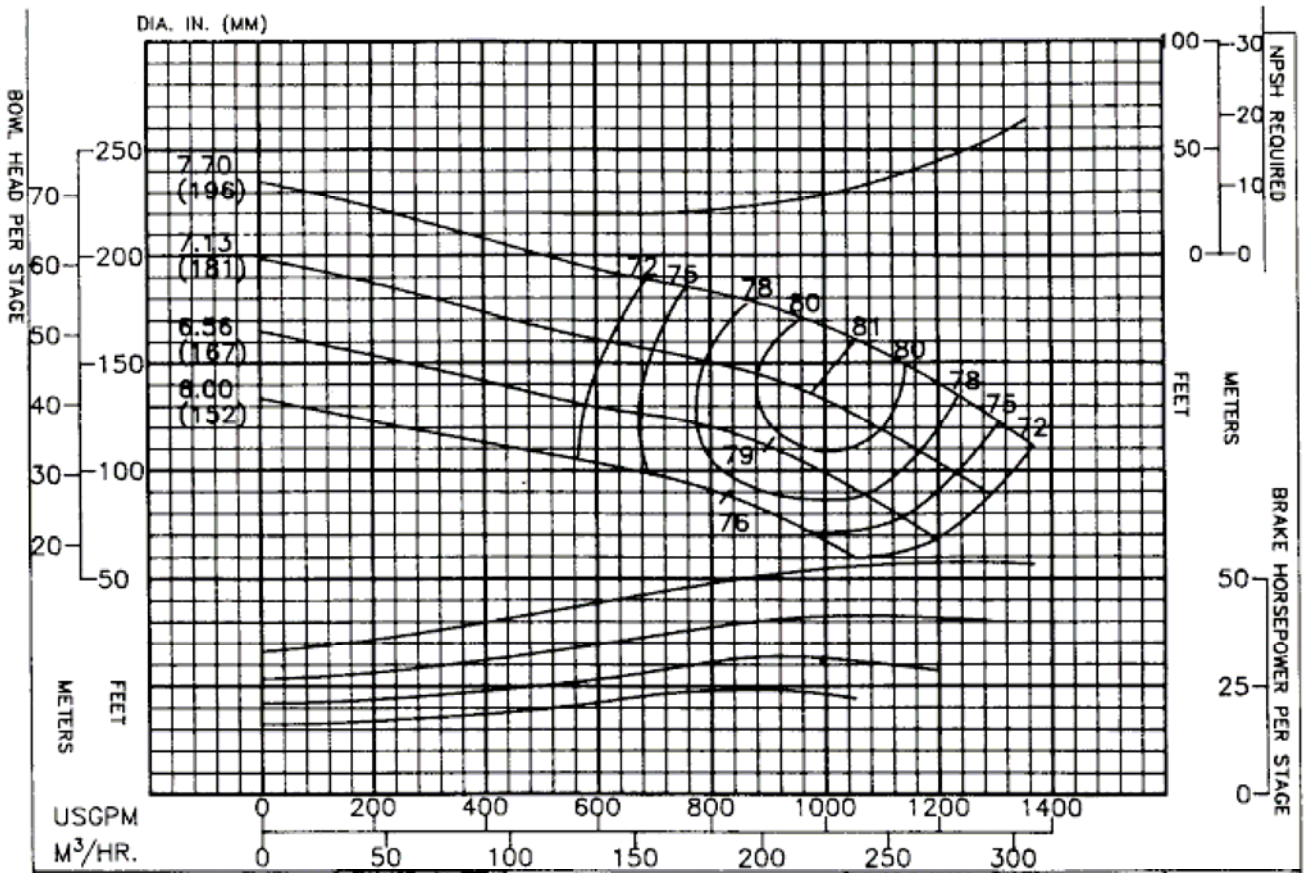

PERFORMANCE BASED ON PUMPING CLEAR WATER BELOW 85°F. WITH LISTED MATLS. COLUMN LOSSES NOT INCLUDED.	CHANGE STAGES	IN EFF. POINTS	INGERSOLL-RAND PUMPS VERTICAL PUMP DIVISION HASTINGS, NE	THRUST FACTORS AT BEP		RPM 3550	PUMP 10KKH
BOWL – CAST IRON – LINED	1	2		IMPELLER	LBS/FT	KG/M	ENCLOSED IMPELLER
IMPELLER – BRONZE	2	1		STANDARD	4.50	6.70	CURVE NO.
	3	0		BALANCED	2.40	3.60	EC–1374
				EYE AREA–11.7 SQ. IN.		N_s = 2550	